

二十四小時電話諮詢熱線：2824 5000

互聯網址：http://www.wsd.gov.hk/

電子郵件：wsdinfo@wsd.gov.hk

24-hour Telephone Enquiry Hotline: 2824 5000

Web Site Address: http://www.wsd.gov.hk/

Email: wsdinfo@wsd.gov.hk

水錶測試實驗室 Meter Testing Laboratory

地址：九龍龍翔道300號水務署機電工場2樓

電話：2339 3511

辦公時間：

星期一至五：上午九時至下午十二時三十分及

下午一時三十分至下午六時

星期六、星期日及公眾假期停止辦公

Address: 2/F, WSD M&E Workshop,
300 Lung Cheung Road, Kowloon


Telephone No.: 2339 3511

Business Hour:

Monday to Friday: 9 a.m. to 12:30 p.m. & 1:30 p.m. to 6 p.m.

Closed on Saturday, Sunday & Public Holidays

水錶測試系統示意圖 Water Meter Testing Schematic Diagram

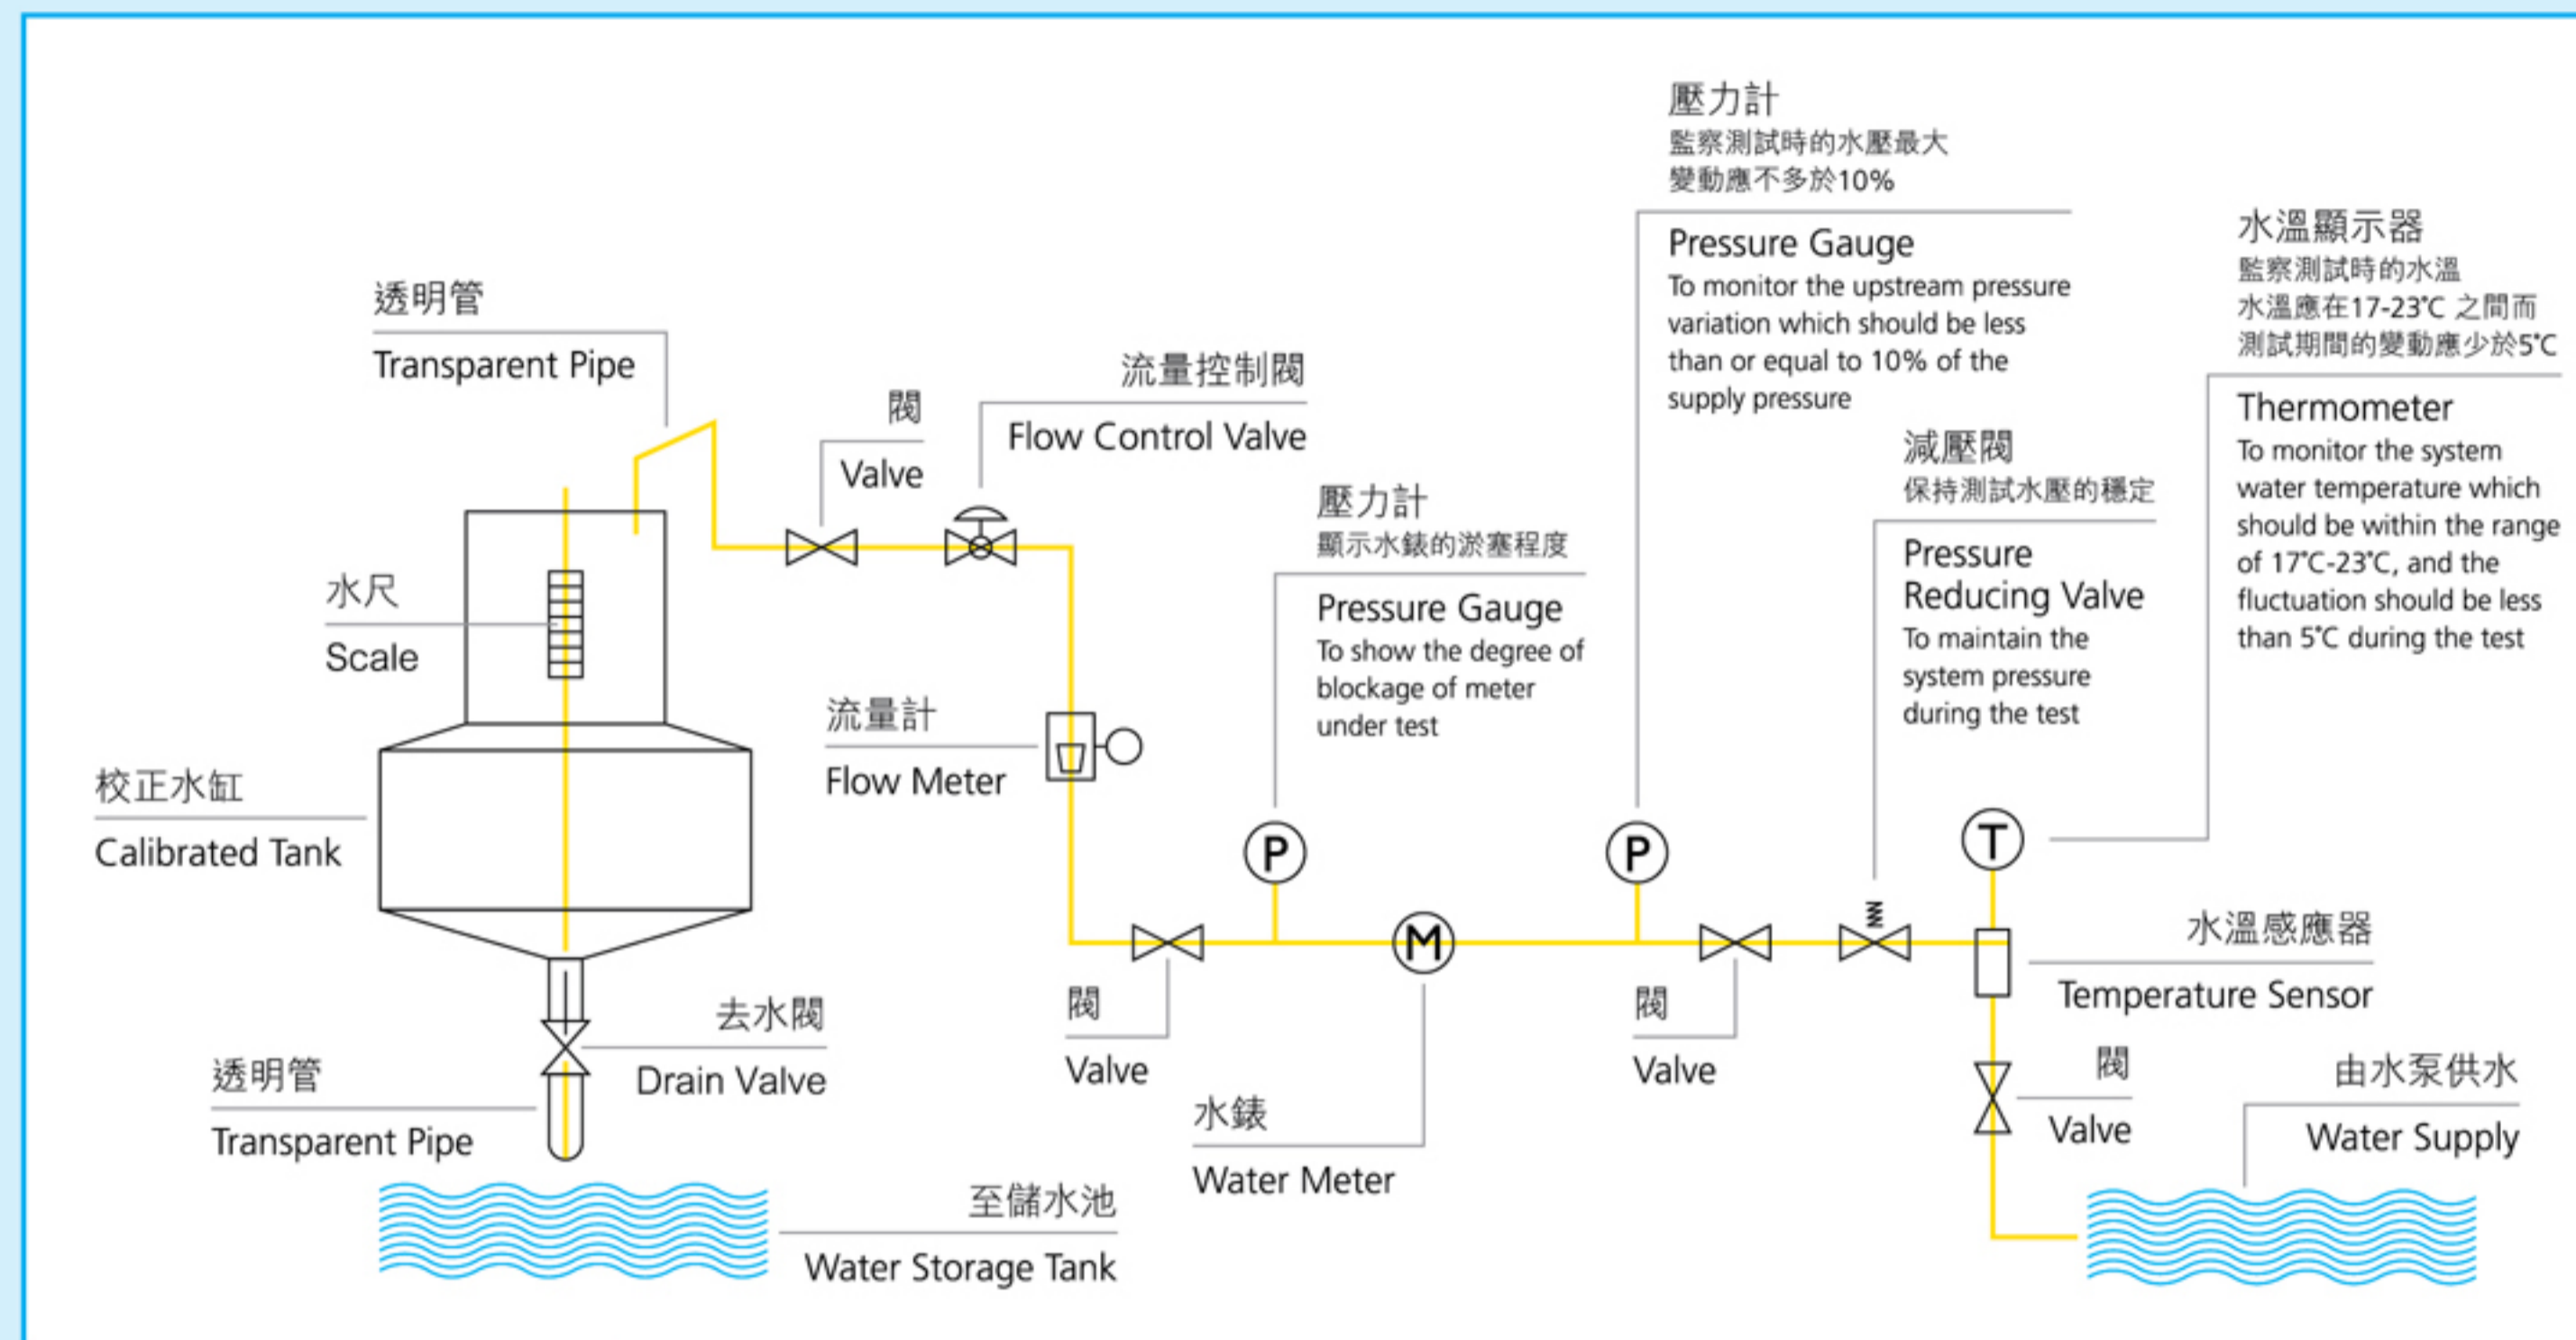

根據水務設施規例
第四部30(2)條所規定，
如水錶的準確程度不超過或不低於
正常度數的3%，則該水錶在記錄用
水量方面將視作記錄正確。

According to Reg. 30(2) of part IV of the
Waterworks Regulations, a meter shall
be deemed to register correctly if
its accuracy does not exceed 3
percent above or below
correct amount.

測試結果的計算

假設：

- ◆ 水錶錄得的水量為 V_m
- ◆ 「校正水缸」量得的水量為 V_t
- ▶ 則水錶的不準確度為 $\frac{V_m - V_t}{V_t} \times 100\%$

Test Result Calculation

Assuming:

- ◆ Quantity of water registered by the meter = V_m
- ◆ Quantity of water collected by the Calibrated Tank = V_t
- ▶ Then, water meter inaccuracy = $\frac{V_m - V_t}{V_t} \times 100\%$

水錶測試 實驗室 Meter Testing Laboratory

本實驗室乃香港實驗所認可的實驗所，指定的試驗項目載於認可計劃的認可實驗所名冊內。

The laboratory is accredited by HOKLAS for specific tests as listed in the HOKLAS Directory of Accredited Laboratories.

