


ROOF PLAN
(FOR 900 x 600 MANHOLE OPENING)

NOTES :

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. THE EXACT POSITION OF ANY OPENING THROUGH THE WALL SHALL BE DETERMINED BY THE ENGINEER ON SITE. ANY REINFORCEMENT ENCOUNTERING THE OPENINGS SHALL BE ADJUSTED TO SUIT THE REQUIREMENT.
3. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH DRAWING NO. WSD 3.7.
4. FOR DESCRIPTION OF REINFORCEMENT REFER TO DRAWING NO. WSD 7.1.
5. ALL REINFORCED CONCRETE SHALL BE GRADE 35/20D. BLINDING CONCRETE SHALL BE GRADE 20/20D.
6. NOMINAL COVER TO REINFORCEMENT SHALL BE 40mm UNLESS OTHERWISE SPECIFIED.



C	GENERAL REVISION	S.K. YEUNG	2/1/15
B	RE-FORMATTED TO CSWP	W.K. CHIU	18/7/03
A	R.C. DETAILS FOR 600 SQ. MANHOLE OPENING ADDED	W.K. CHIU	3/8/00
REF.	REVISION	APPROVED	DATE

RODDING PIT FOR UNDER FLOOR DRAINS –
R.C. DETAILS
(DEPTH NOT EXCEEDING 6m)




水務署
Water Supplies Department

APPROVED	G.C. LEE AD/NW	DRAWING NO.	CSWP
DATE	9/6/92	WSD 3.8C	
SCALE	1 : 20	(SHEET 1 OF 6)	




WSD 3.8C
(SHEET 2 OF 6)

Cad Ref. : WSD030803-C.dwg

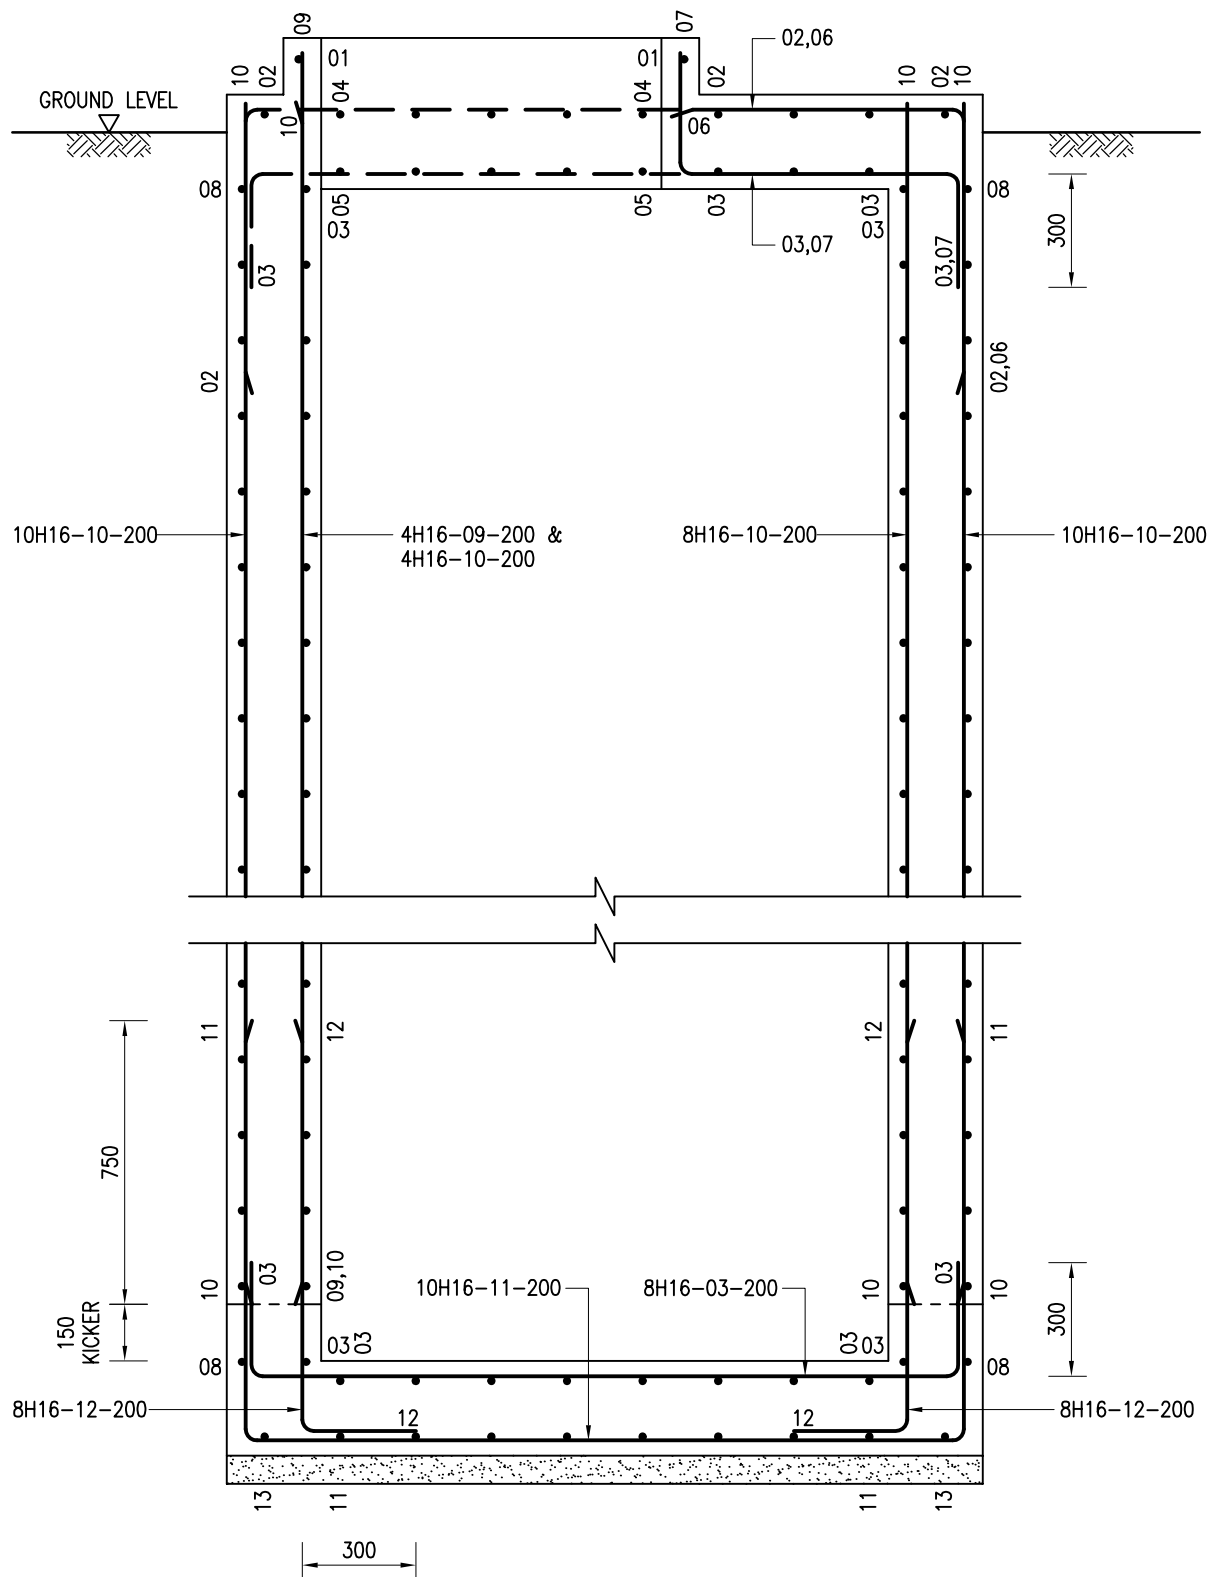

SECTION A - A



1 : 20 SCALE BAR

RODDING PIT FOR UNDER FLOOR
DRAINS -
R.C. DETAILS
(DEPTH NOT EXCEEDING 6m)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE


1 : 20

DRAWING NO.


WSD 3.8C

(SHEET 3 OF 6)

CSWP

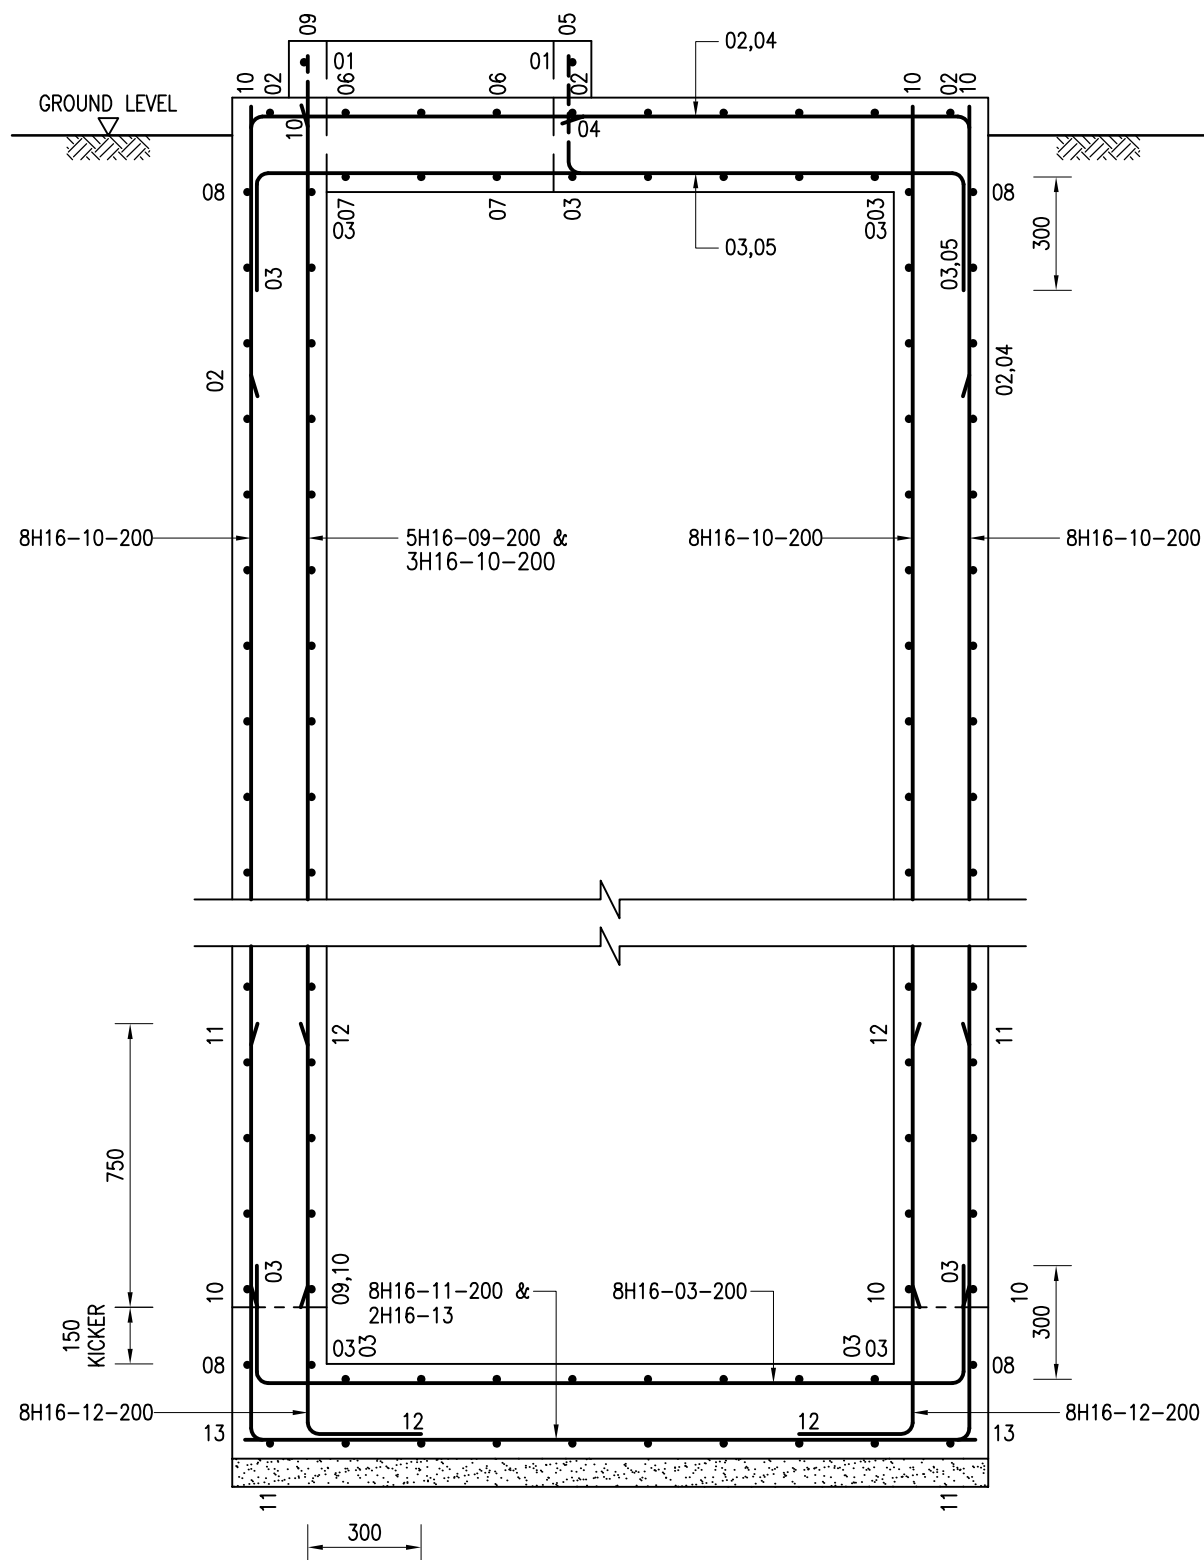

SECTION B - B




RODDING PIT FOR UNDER FLOOR
DRAINS –
R.C. DETAILS
(DEPTH NOT EXCEEDING 6m)




水務署
Water Supplies Department

APPROVED	G.C. LEE AD/NW	DRAWING NO. WSD 3.8C (SHEET 4 OF 6)	CSWP
DATE	9/6/92		
SCALE	1 : 20		

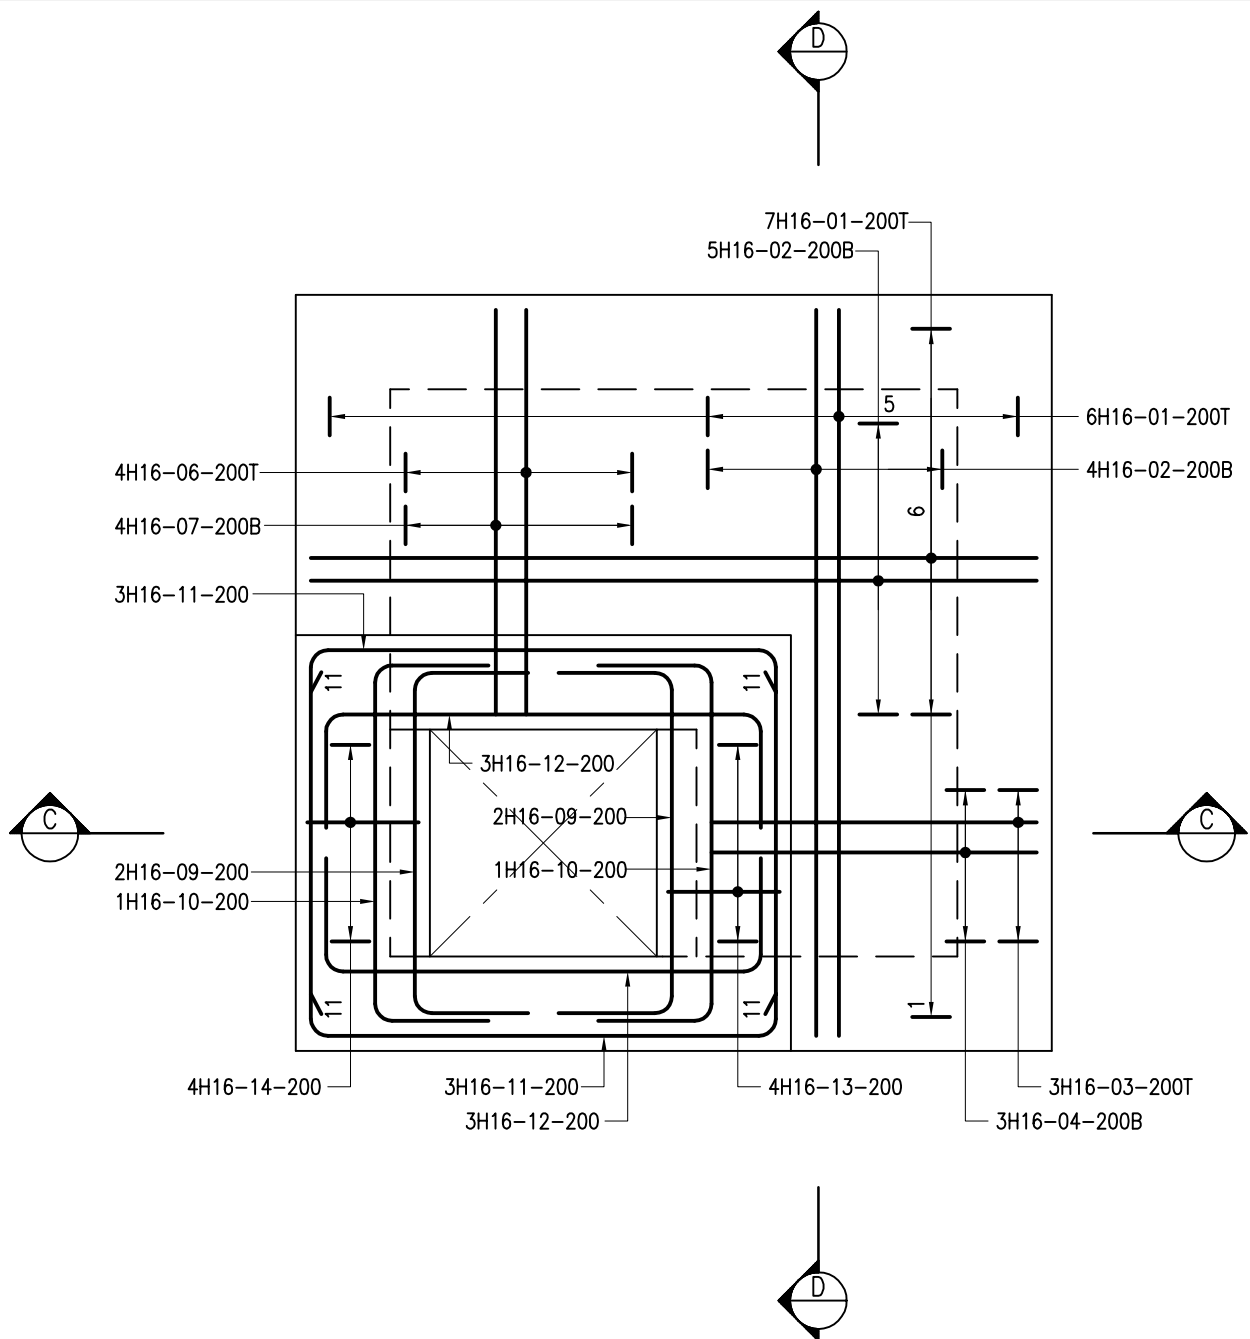

ROOF PLAN
(FOR 600 x 600 MANHOLE OPENING)



Cad Ref. : WSD030805-C.dwg

RODDING PIT FOR UNDER FLOOR
DRAINS –
R.C. DETAILS
(DEPTH NOT EXCEEDING 6m)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE


1 : 20

DRAWING NO.


WSD 3.8C

(SHEET 5 OF 6)


CSWP

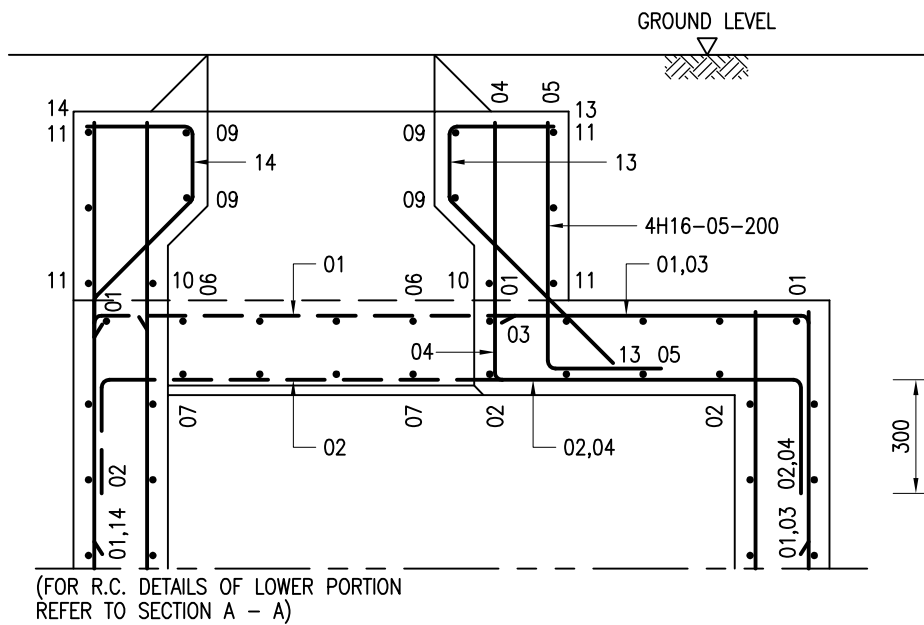

SECTION C - C

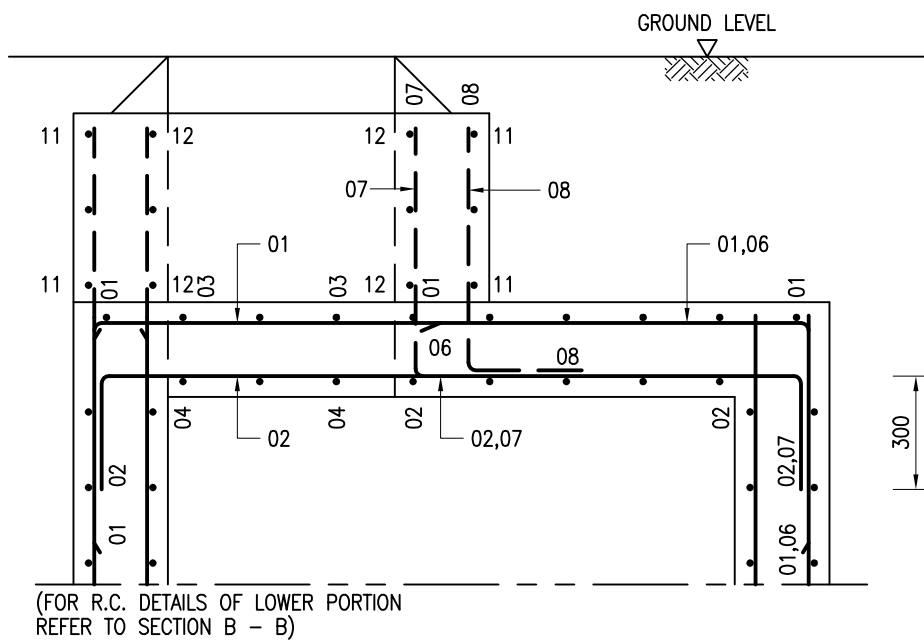

SECTION D - D



RODDING PIT FOR UNDER FLOOR
DRAINS -
R.C. DETAILS
(DEPTH NOT EXCEEDING 6m)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE

1 : 20

DRAWING NO.

WSD 3.8C

(SHEET 6 OF 6)

CSWP