



SECTION A - A

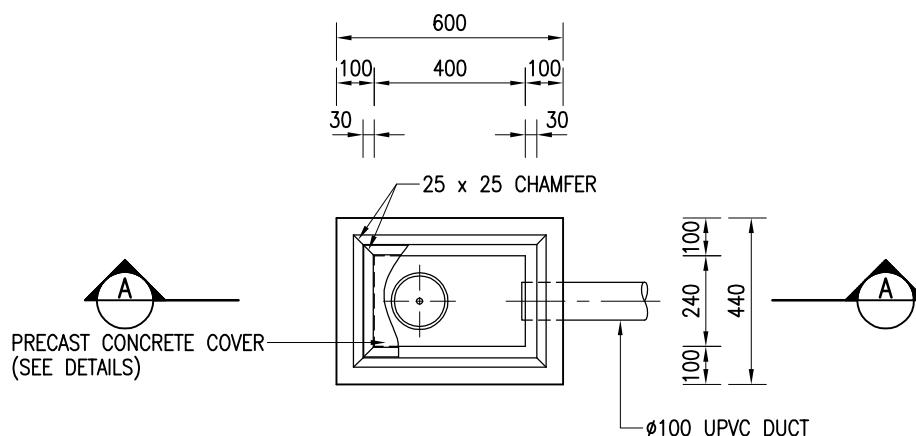

PLAN

NOTES :

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SPECIFIED.
2. CONCRETE FOR PIT SHALL BE GRADE 30/20D.
3. NOMINAL COVER TO REINFORCEMENT SHALL BE 40mm FOR PIT AND 25mm FOR PRECAST CONCRETE COVER UNLESS OTHERWISE SPECIFIED.
4. FOR DESCRIPTION OF REINFORCEMENT REFER TO DRAWING NO. WSD 7.1.
5. PRECAST CONCRETE UNITS MAY BE USED AS AN ALTERNATIVE FORM OF CONSTRUCTION IF APPROVED BY THE ENGINEER.
6. UNC DENOTES UNIFIED NATIONAL COARSE THREAD.
7. UPVC DUCT SHALL BE SEALED UP IN ACCORDANCE WITH DRAWING NO. WSD 7.16.




D	GENERAL REVISION	S.K. YEUNG	2/1/15
C	NOTE 5 ADDED	M.K. HA	26/11/08
B	RE-FORMATED TO CSWP	W.K. CHIU	18/7/03
A	EARTH CONNECTION DETAILS REVISED	W.K. CHIU	10/10/00
REF.	REVISION	APPROVED	DATE

EARTHING PIT




水務署
Water Supplies Department

APPROVED	G.C. LEE AD/NW	DRAWING NO.	CSWP
DATE	9/6/92	WSD 2.18D	
SCALE	1 : 20	(SHEET 1 OF 3)	

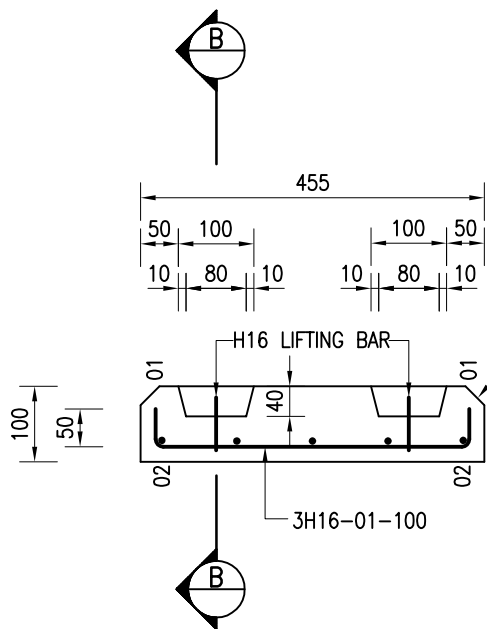


PRECAST CONCRETE COVER

SCALE 1 : 10

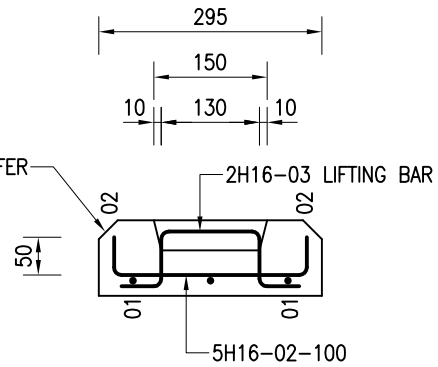


SECTION B - B

SCALE 1 : 10

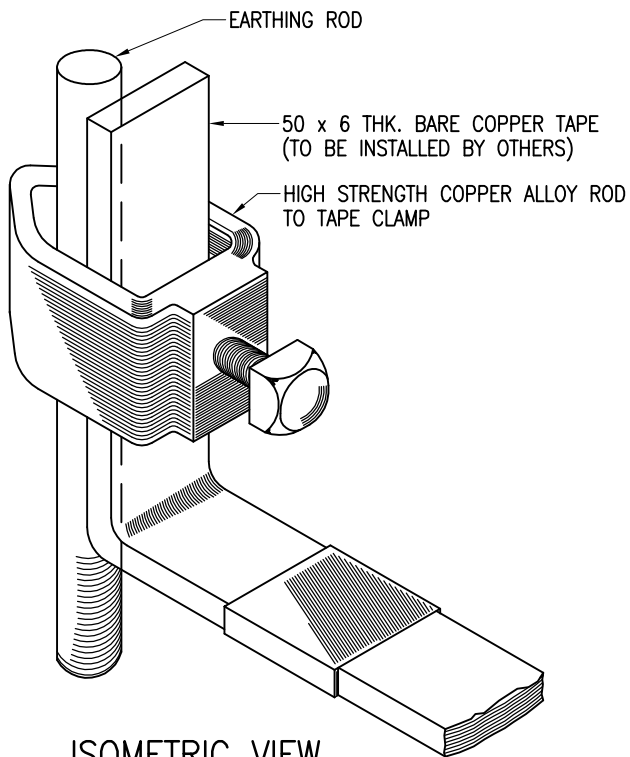


ISOMETRIC VIEW

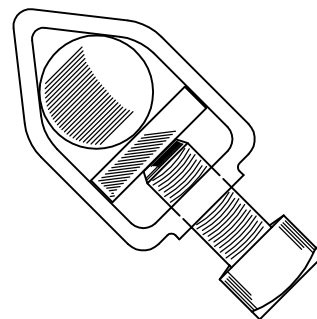

PLAN

EARTH CONNECTION CLAMP FOR EARTHING ROD

N.T.S.



Cad Ref. : WSD021802-D.dwg

EARTHING PIT



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92



SCALE

1 : 10 OR AS SHOWN

DRAWING NO.

WSD 2.18D
(SHEET 2 OF 3)

CSWP

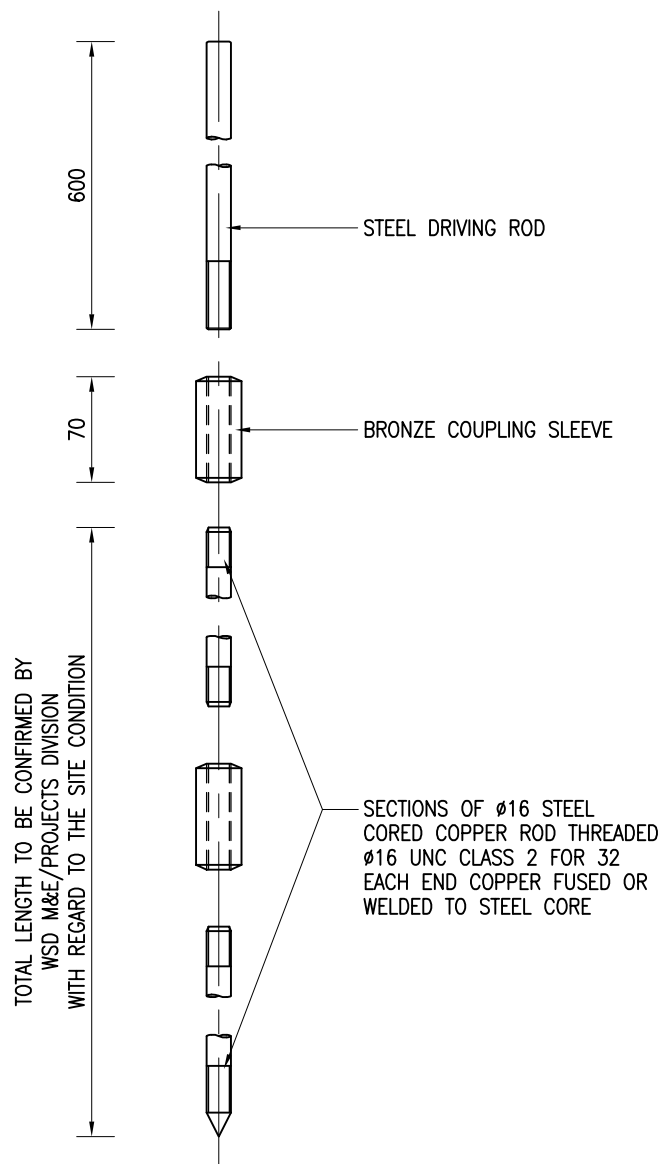

EARTHING PIT



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE

1 : 5

DRAWING NO.

WSD 2.18D
(SHEET 3 OF 3)

CSWP