

Cad Ref. : WSD023301-C.dwg

C	GENERAL REVISION	S.K. YEUNG	12/1/15
---	------------------	------------	---------


METAL GATE AND CHAIN LINK
FENCE WITH STEEL ANGLE POST
FOR OUTDOOR SUBSTATION
(CLP REQUIREMENTS)


B	RE-FORMATTED TO CSWP	W.K. CHIU	18/7/03
A	GENERAL REVISION	W.K. CHIU	10/10/00
REF.	REVISION	APPROVED	DATE




水務署
Water Supplies Department

APPROVED	G.C. LEE AD/NW	DRAWING NO.	CSWP
DATE	9/6/92	WSD 2.33C	
SCALE	N.T.S.	(SHEET 1 OF 3)	

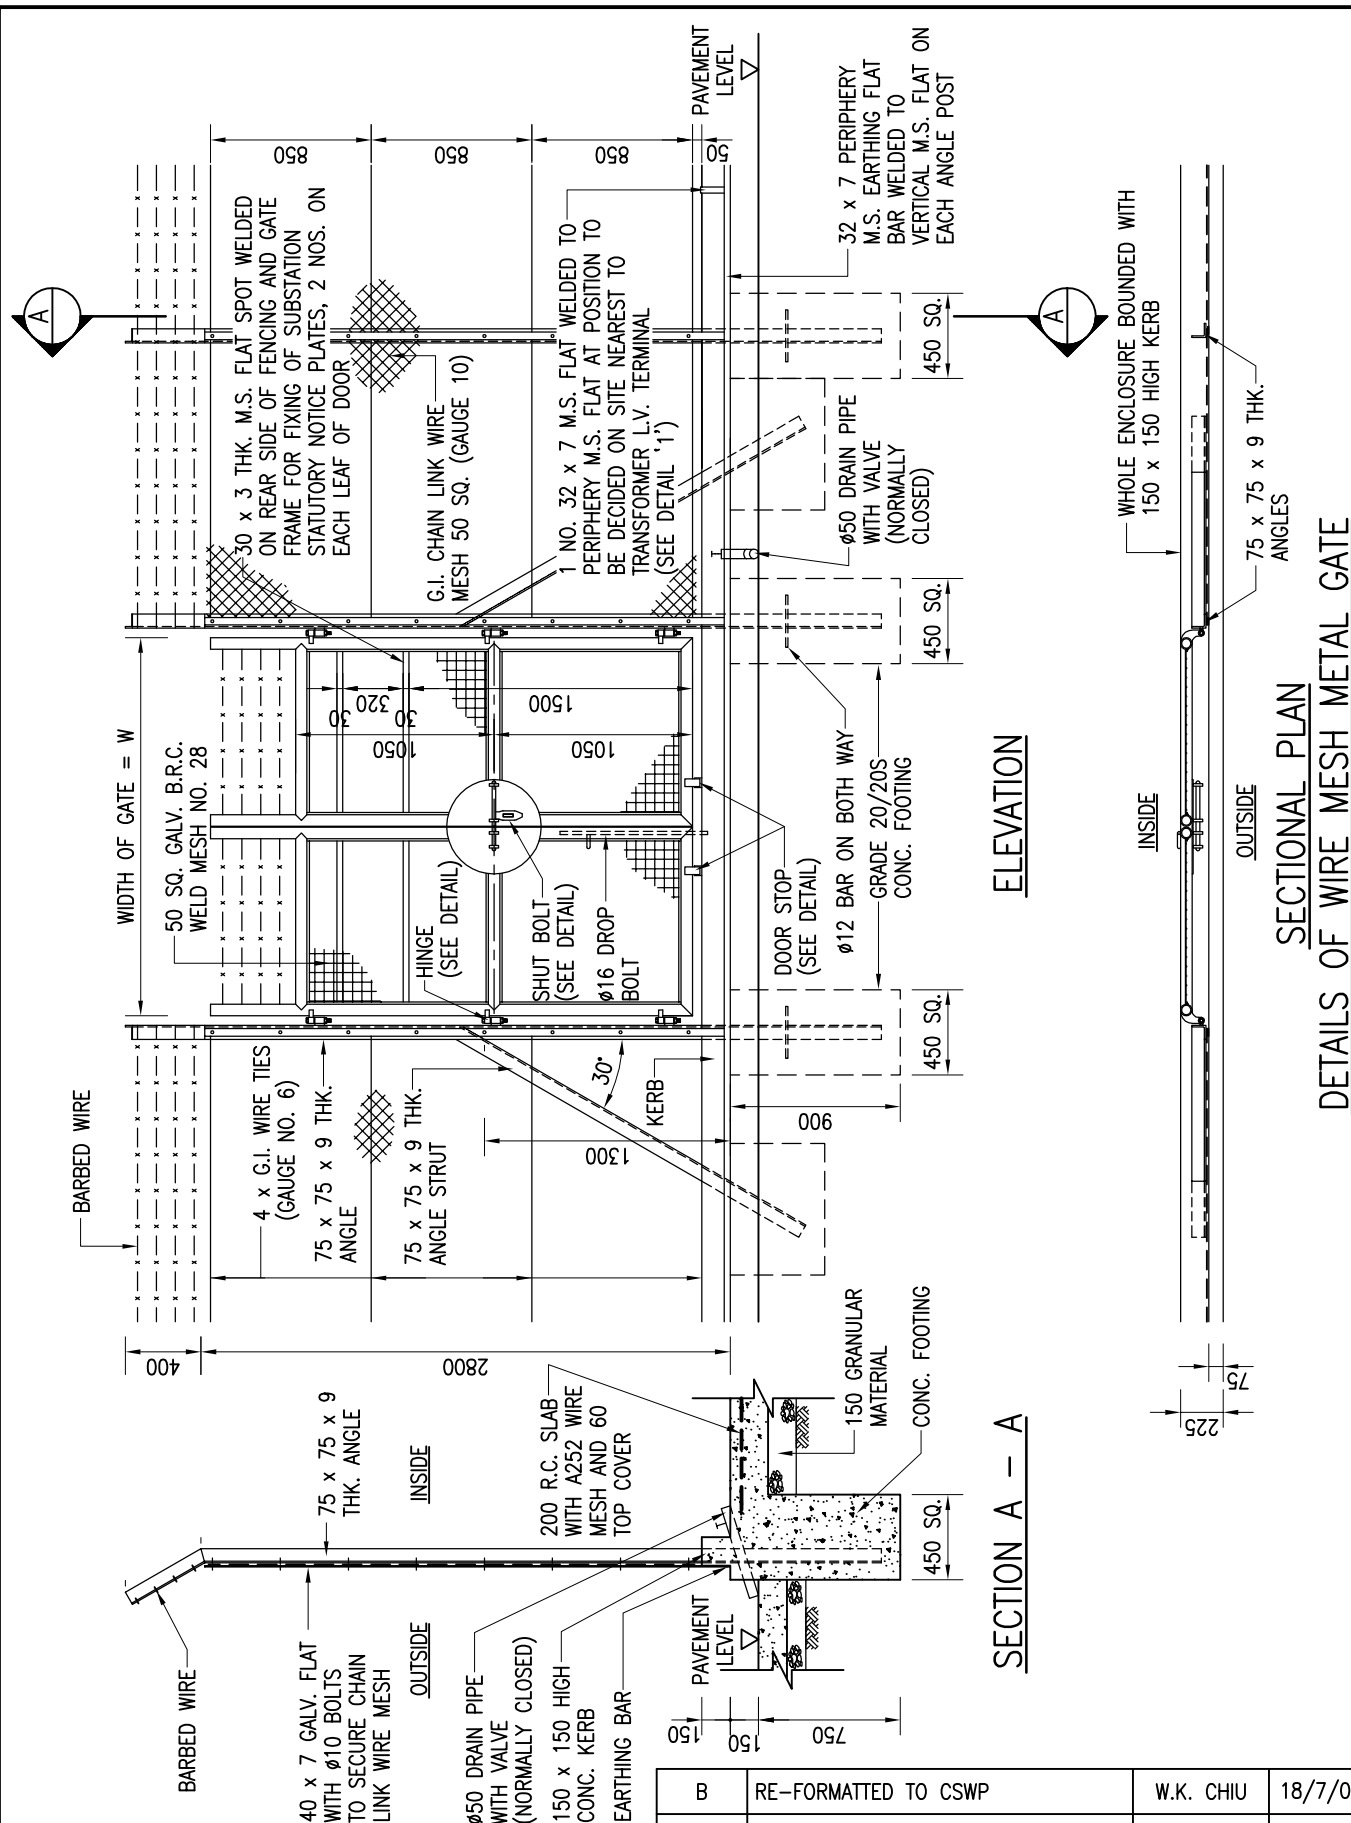


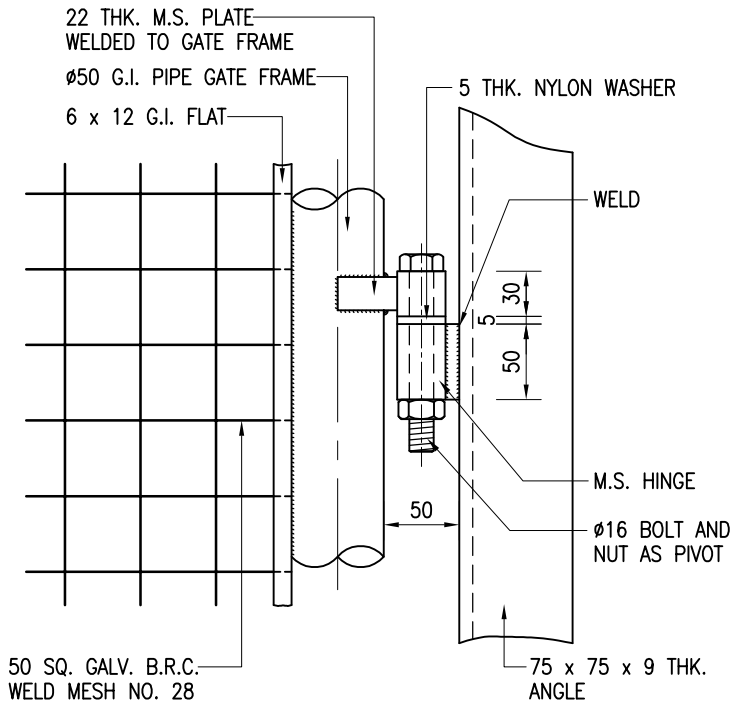


ELEVATION

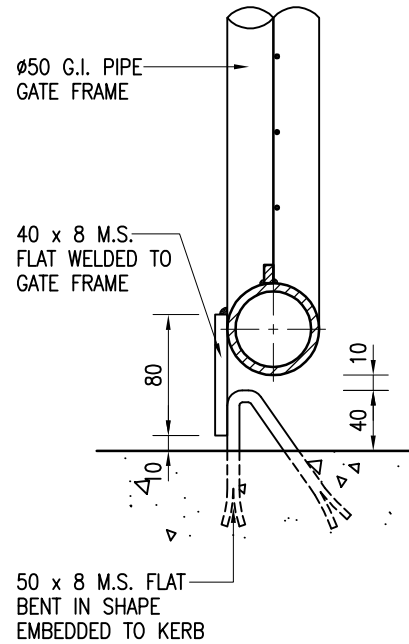

DETAILS OF DOOR STOP

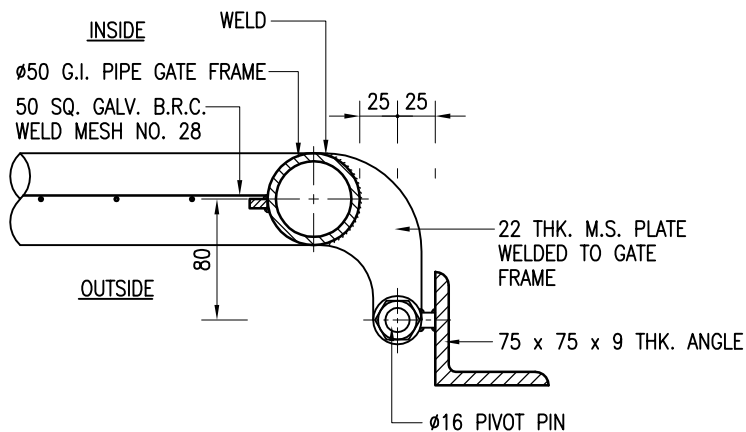

PLAN
DETAILS OF HINGE



Cad Ref. : WSD023302-C.dwg

METAL GATE AND CHAIN LINK
FENCE WITH STEEL ANGLE POST
FOR OUTDOOR SUBSTATION
(CLP REQUIREMENTS)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE


1 : 5

DRAWING NO.

WSD 2.33C


(SHEET 2 OF 3)

CSWP

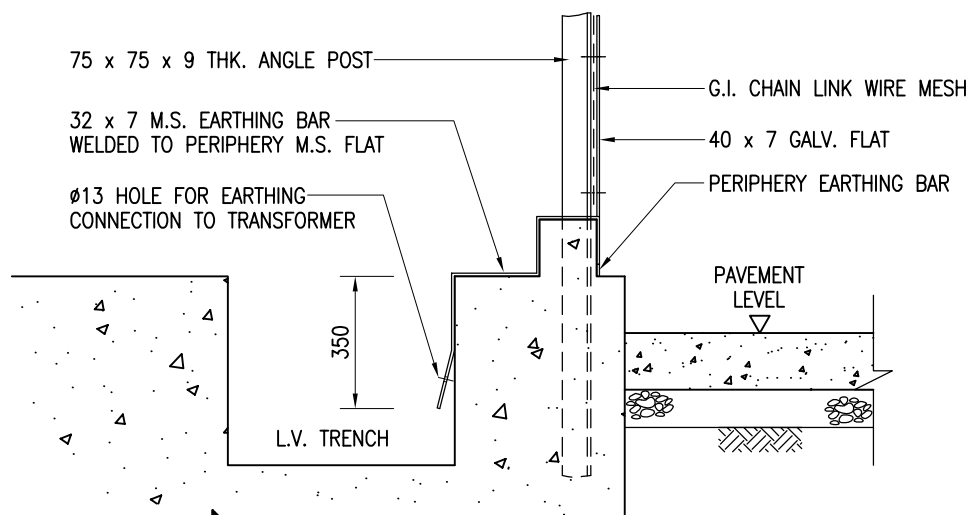


DETAIL '1'

SCALE 1 : 20

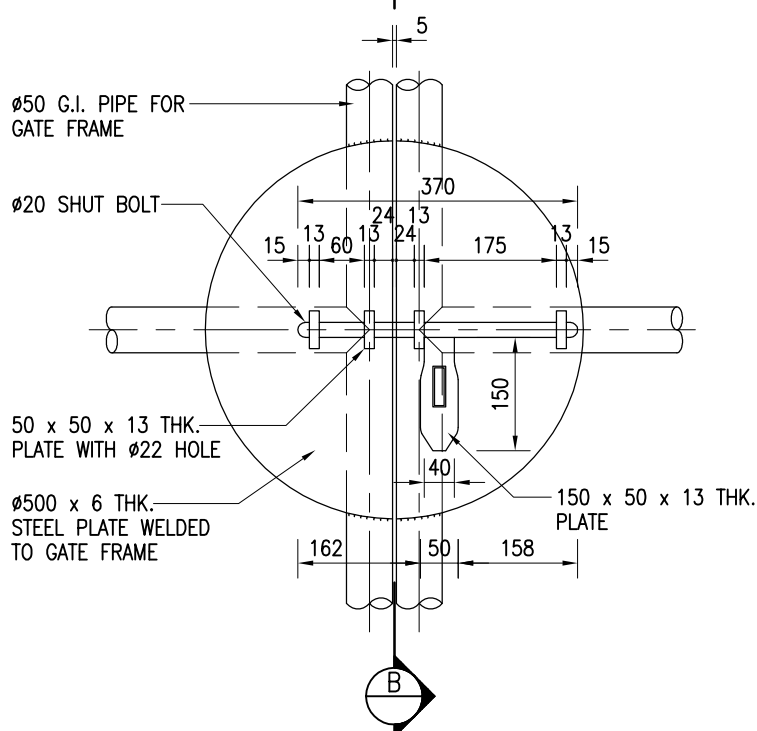

FRONT ELEVATION

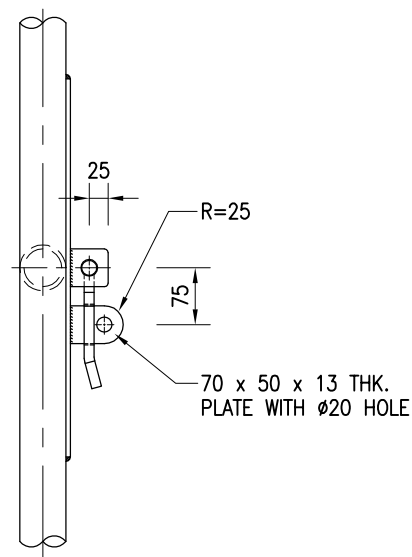


SECTION B - B

DETAILS OF SHUT BOLT

SCALE 1 : 10

NOTES :

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. ALL STEELWORKS SHALL BE HOT-DIP GALVANIZED TO BS EN ISO 1461 AND FINISHED WITH ONE COAT OF CALCIUM PLUMBATE PRIMER AND TWO FINISHING COATS OF SYNTHETIC PAINT.
3. STEEL ANGLE STRUT SHALL BE PROVIDED TO THE END OR CORNER POSTS.
4. DIMENSION W SHALL BE AS SHOWN ON THE CONTRACT DRAWINGS.



1 : 10 SCALE BAR



1 : 20 SCALE BAR

Cad Ref. : WSD023303-C.dwg

METAL GATE AND CHAIN LINK
FENCE WITH STEEL ANGLE POST
FOR OUTDOOR SUBSTATION
(CLP REQUIREMENTS)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE

1 : 20 OR AS SHOWN

DRAWING NO.

WSD 2.33C

(SHEET 3 OF 3)

CSWP