




SECTION B - B
N.T.S.

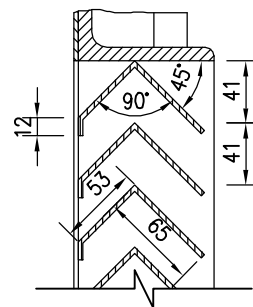


DETAIL '1'
SCALE 1 : 5

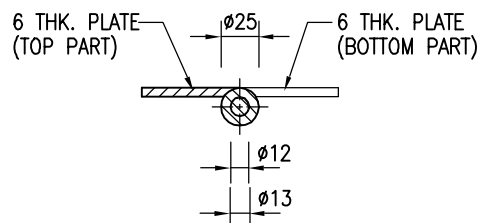

SECTION C - C

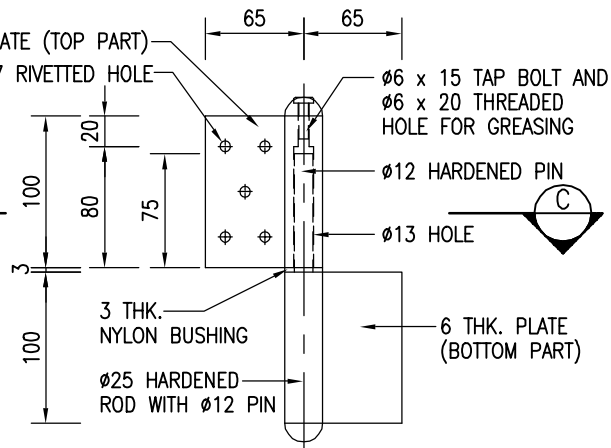

**ELEVATION
DETAILS OF HINGE**
SCALE 1 : 5



TYPICAL DETAILS OF SINGLE-LEAF
STAINLESS STEEL DOOR
(CLP REQUIREMENTS)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE

1 : 5 OR AS SHOWN


DRAWING NO.

WSD 2.28B


(SHEET 2 OF 4)

CSWP


Cad Ref. : WSD022803-B.dwg

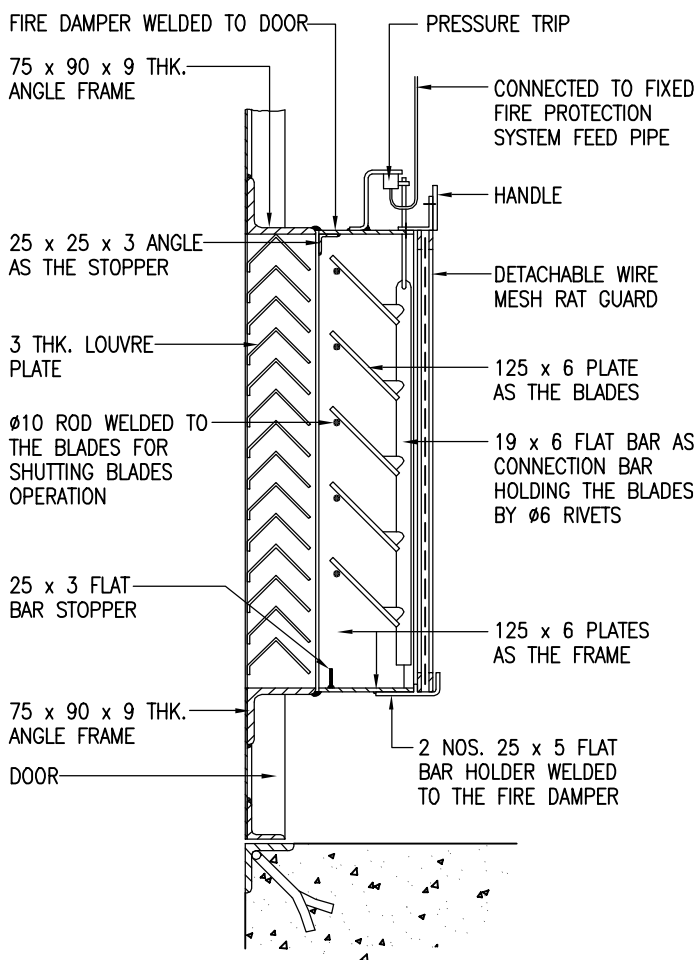

DETAIL '2'
(SECTION FOR FIXING FIRE DAMPER
AND WIRE MESH RAT GUARD)

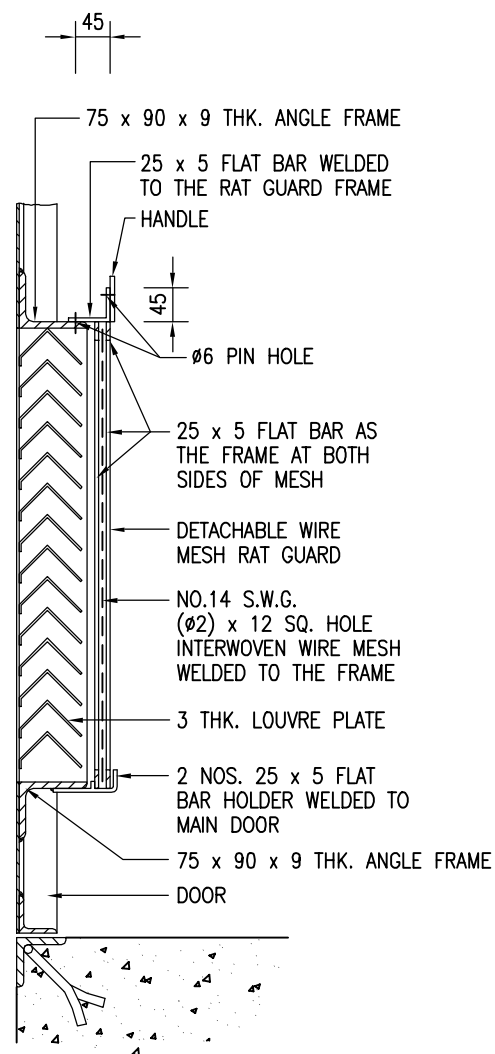

DETAIL '3'
(SECTION FOR FIXING WIRE
MESH RAT GUARD ONLY)



TYPICAL DETAILS OF SINGLE-LEAF
STAINLESS STEEL DOOR
(CLP REQUIREMENTS)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE



1 : 10

DRAWING NO.

WSD 2.28B

(SHEET 3 OF 4)

CSWP

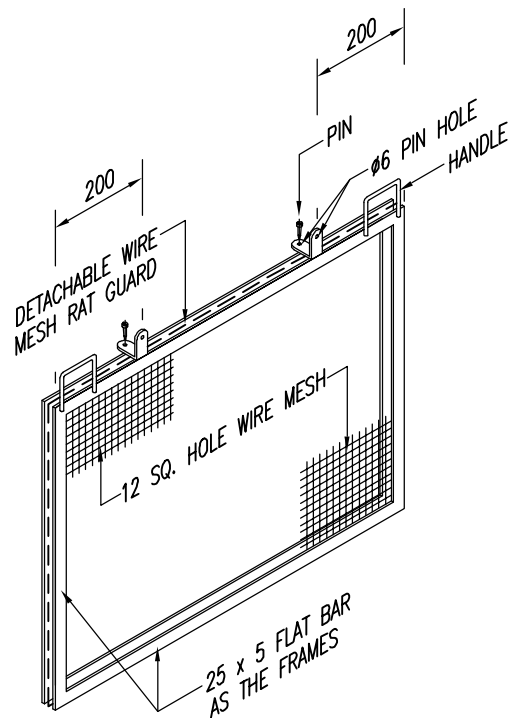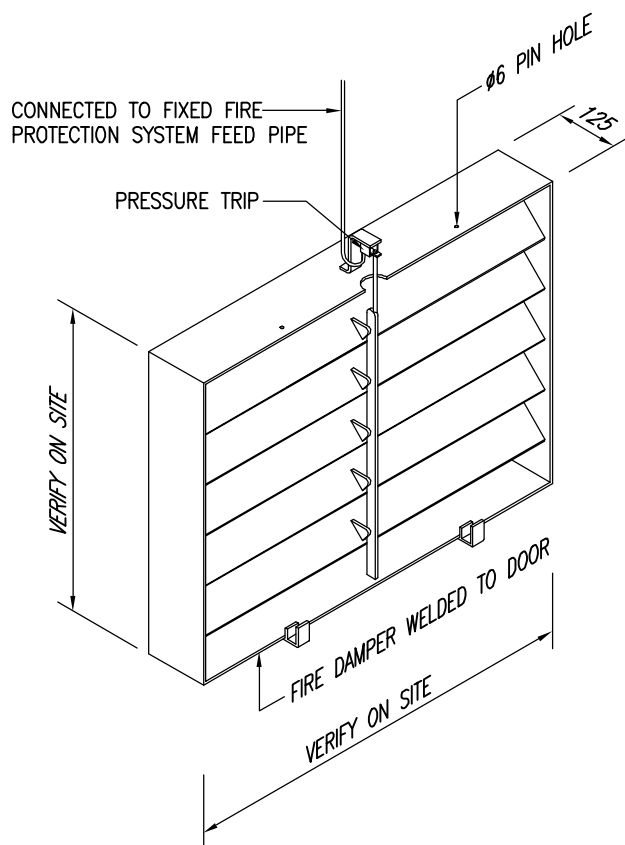

ISOMETRIC VIEW AND ASSEMBLAGE OF
FIRE DAMPER AND WIRE MESH RAT GUARD

NOTES :

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. ALL CONNECTIONS OF STAINLESS STEEL WORKS SHALL BE WELDED.
3. ALL STEEL WORKS SHALL BE GRADE 316 S12 STAINLESS STEEL TO BS 970.
4. ALL STEEL WORKS MUST BE BONDED TO THE EARTHING TERMINAL AT THE DISTRIBUTION BOARD WITH COPPER CONDUCTOR NOT LESS THAN 6mm².
5. DIMENSION H AND W SHALL BE AS SHOWN ON THE CONTRACT DRAWINGS.
6. THE EMERGENCY EXIT DEADLOCK SET WITH PANIC BOLT SHALL BE PROVIDED BY CLP AND INSTALLED BY THE CIVIL CONTRACTOR.
7. THE STANDARD LOCK SHALL BE PROVIDED AND INSTALLED BY CLP.

TYPICAL DETAILS OF SINGLE-LEAF
STAINLESS STEEL DOOR
(CLP REQUIREMENTS)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE

N.T.S.

DRAWING NO.

WSD 2.28B
(SHEET 4 OF 4)

CSWP