



ELEVATION

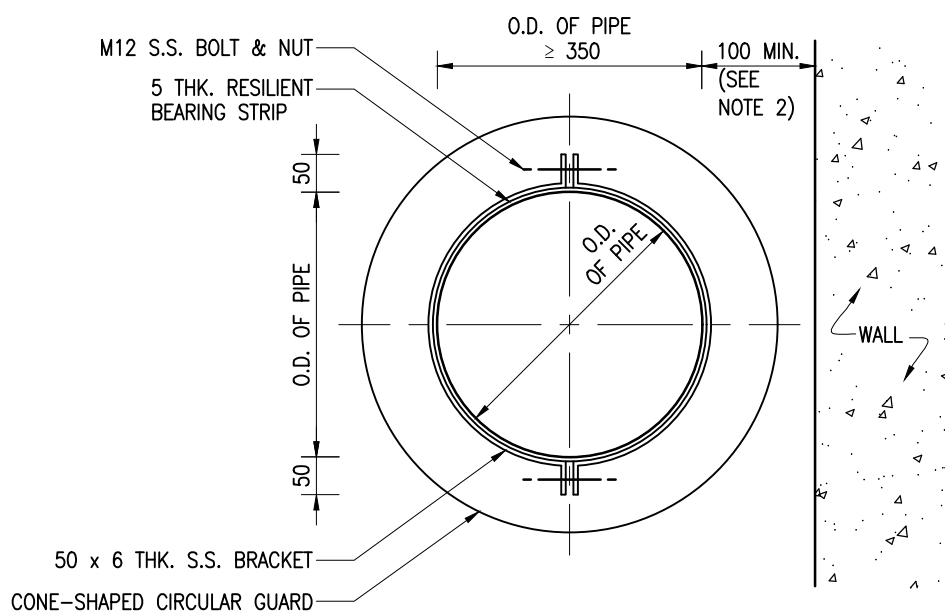

PLAN

RODENT GUARD FOR PIPE WITH NOMINAL DIAMETER EXCEEDING 350mm




REF.	REVISION	APPROVED	DATE

RODENT GUARD




水務署
Water Supplies Department

APPROVED	STANLEY C.Y. CHAN AD/NW	DRAWING NO.	CSWP
DATE	15/8/23	WSD 2.39	
SCALE	1 : 10	(SHEET 1 OF 2)	

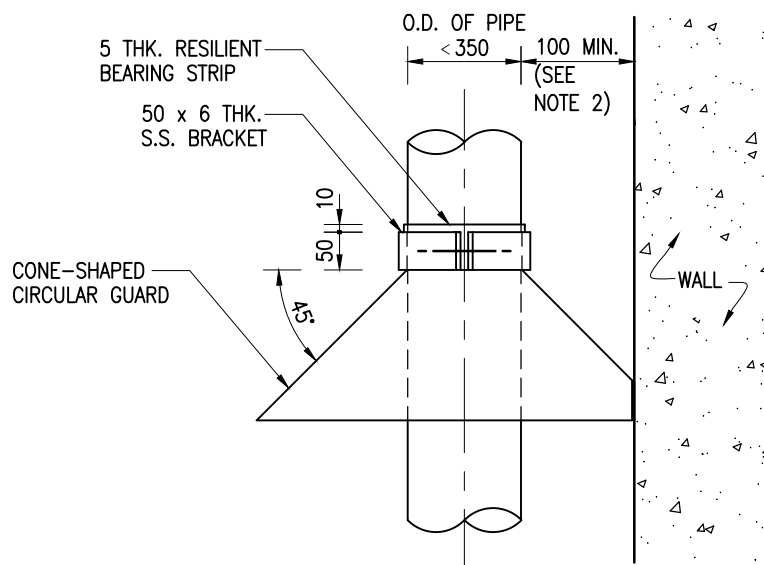

ELEVATION

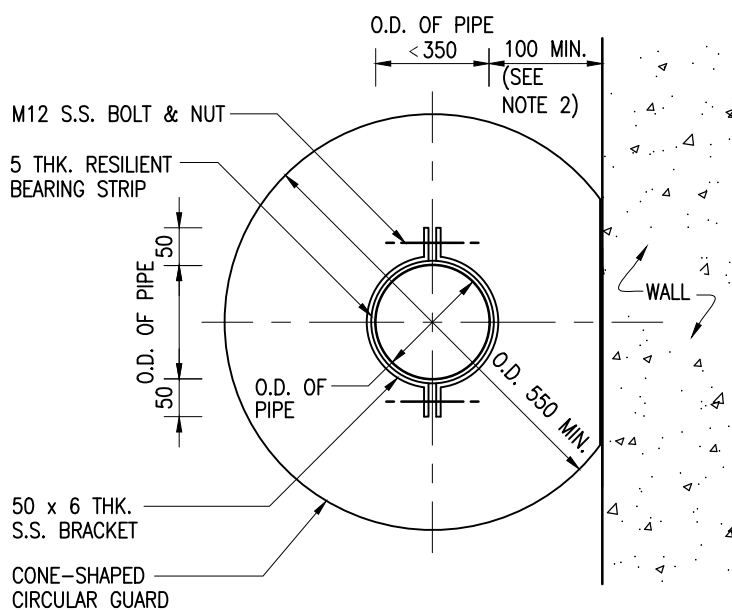


PLAN

RODENT GUARD FOR PIPE WITH NOMINAL DIAMETER LESS THAN 350mm

NOTES :

1. ALL DIMENSION ARE IN MILLIMETRES.
2. AT LEAST 100mm SPACING SHALL BE PROVIDED BETWEEN VERTICAL PIPES, AND BETWEEN PIPES AND THE WALL FACE.



RODENT GUARD



水務署
Water Supplies Department

APPROVED

STANLEY C.Y. CHAN
AD/NW

DATE

15/8/23

SCALE

1 : 10

DRAWING NO.

WSD 2.39

(SHEET 2 OF 2)

CSWP