


ROOF PLAN

(FOR 900 x 600 MANHOLE OPENING)

NOTES :

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. CONCRETE FOR RODDING PIT TO BE GRADE 35/20D.
(FOR USE IN NON-VEHICULAR AREA)
3. THE EXACT POSITION OF ANY OPENING THROUGH THE WALL WILL BE DETERMINED BY THE ENGINEER ON SITE.
4. FOR DETAILS OF CAT-LADDER WITH EXTENSION AND SAFETY CAGE REFER TO DRAWING NO. WSD 7.3.
5. FINISHES SHALL BE OF CLASS U3 OR F3 FOR INTERNAL SURFACES, U2 OR F2 FOR BURIED SURFACES AND U1 FOR BLINDING CONCRETE.
6. WHERE THE RODDING PIT IS LOCATED IN VEHICULAR AREA, MANHOLE OPENING SIZE OF 600 x 600 SHALL BE ADOPTED.
FOR DETAILS OF 600 x 600 MANHOLE OPENING REFER TO DRAWING NO. WSD 3.7.




B	RE-FORMATTED TO CSWP	W.K. CHIU	18/7/03
A	NOTE FOR 600 SQ. MANHOLE OPENING ADDED	W.K. CHIU	3/8/00
REF.	REVISION	APPROVED	DATE

RODDING PIT FOR UNDER FLOOR DRAINS –
GENERAL ARRANGEMENT
(DEPTH BETWEEN 6m AND 9m)




水務署
Water Supplies Department

APPROVED	G.C. LEE AD/NW	DRAWING NO.	CSWP
DATE	9/6/92	WSD 3.9B	
SCALE	1 : 20	(SHEET 1 OF 4)	

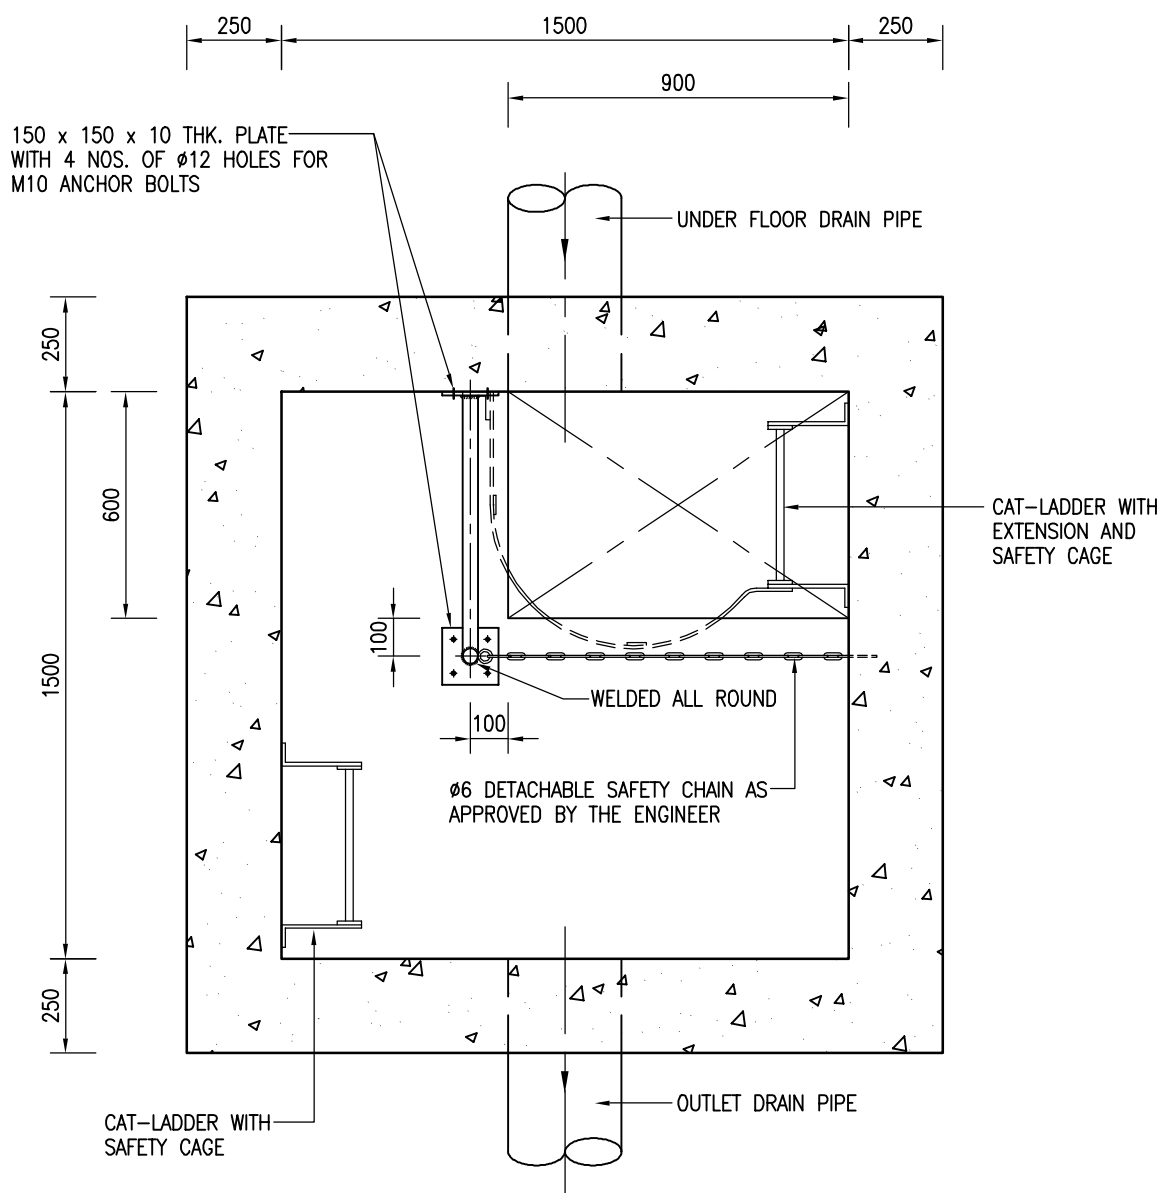

SECTIONAL PLAN



RODDING PIT FOR UNDER FLOOR
DRAINS –
GENERAL ARRANGEMENT
(DEPTH BETWEEN 6m AND 9m)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE

1 : 20


DRAWING NO.

WSD 3.9B

(SHEET 2 OF 4)

CSWP

Cad Ref. : WSD030903-B.dwg

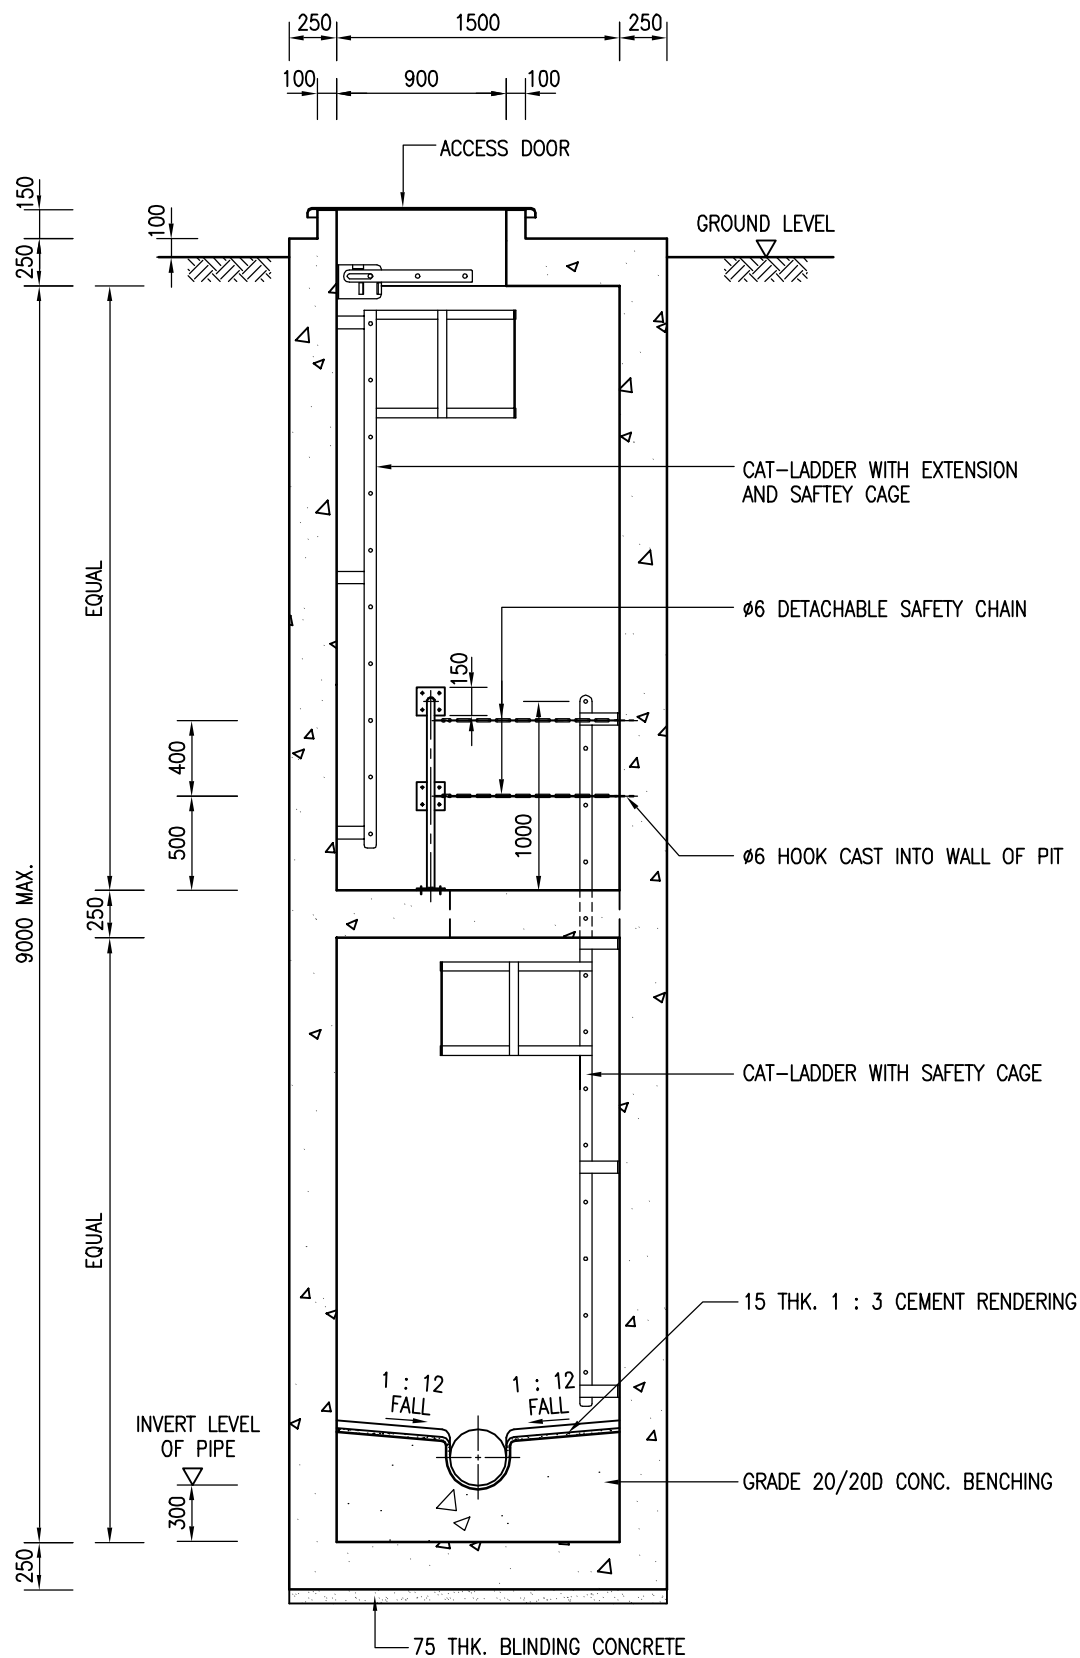

SECTION A - A

RODDING PIT FOR UNDER FLOOR DRAINS –
GENERAL ARRANGEMENT
(DEPTH BETWEEN 6m AND 9m)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE


N.T.S.

DRAWING NO.

WSD 3.9B

(SHEET 3 OF 4)

CSWP

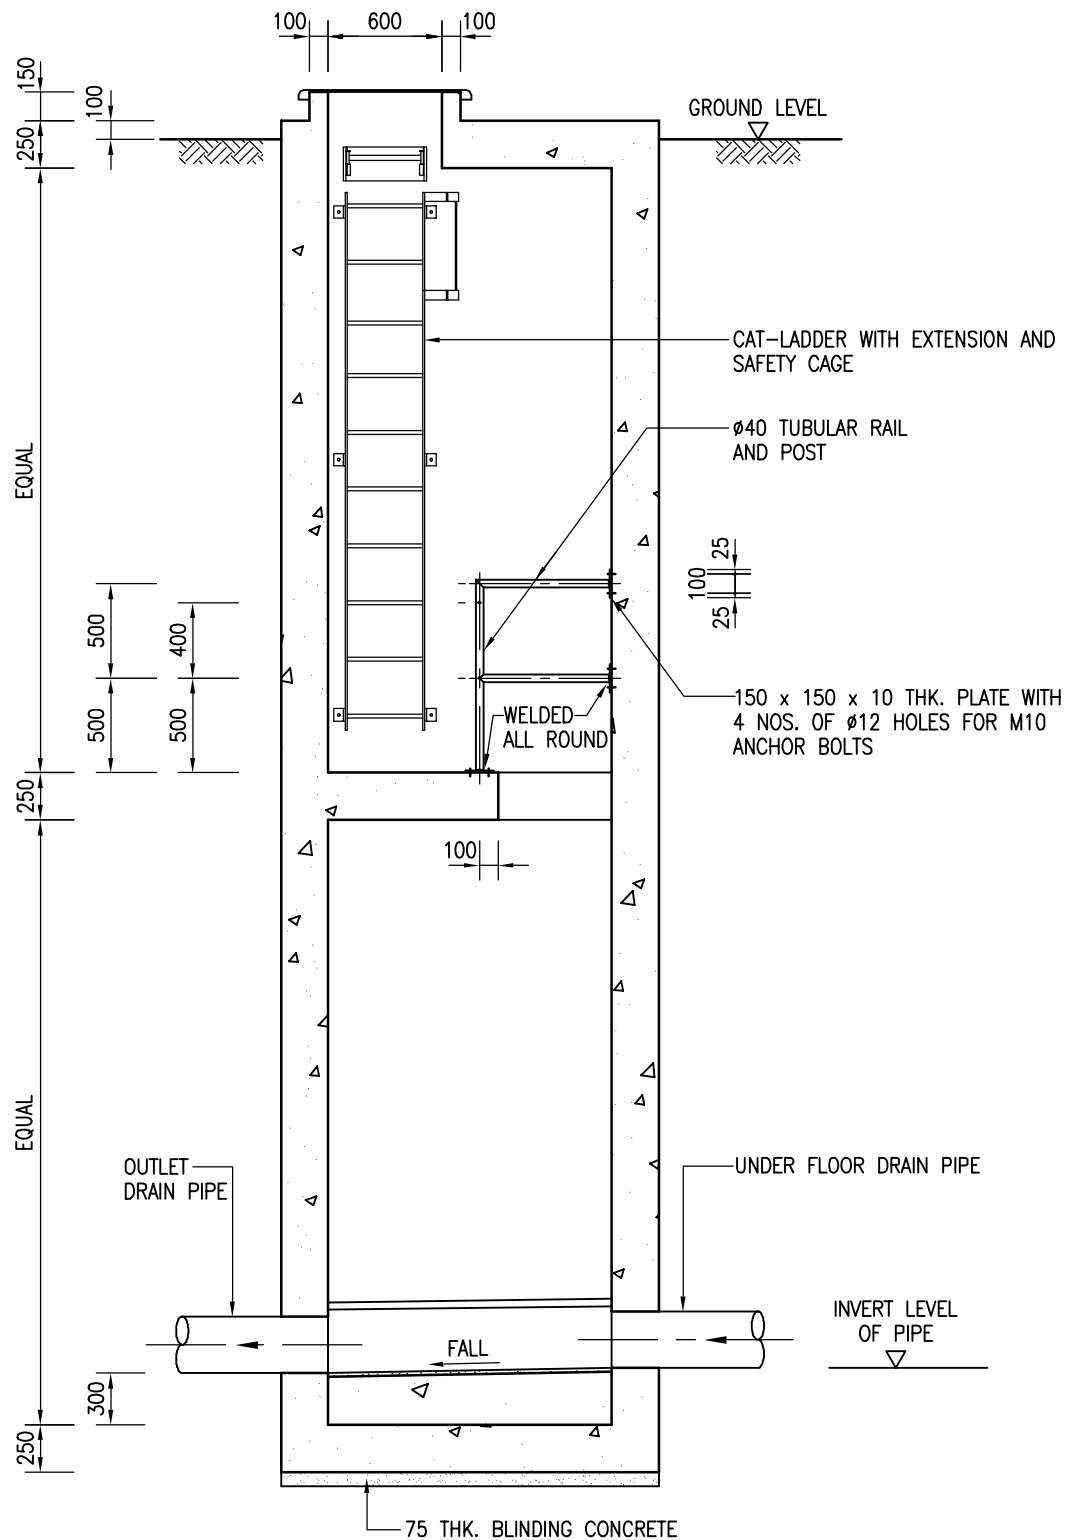

SECTION B - B

RODDING PIT FOR UNDER FLOOR DRAINS -
GENERAL ARRANGEMENT
(DEPTH BETWEEN 6m AND 9m)



水務署
Water Supplies Department

APPROVED

G.C. LEE
AD/NW

DATE

9/6/92

SCALE

N.T.S.

DRAWING NO.

WSD 3.9B

(SHEET 4 OF 4)

CSWP