


PLAN

NOTES :

1. ALL DIMENSIONS ARE IN MILLIMETRES.
2. ALL REINFORCED CONCRETE SHALL BE GRADE 35/20D. BLINDING CONCRETE SHALL BE GRADE 20/20D.
3. NOMINAL COVER TO REINFORCEMENT SHALL BE 40mm UNLESS OTHERWISE SPECIFIED.
4. FOR DESCRIPTION OF REINFORCEMENT REFER TO DRAWING NO. WSD 7.1.
5. MINIMUM LAP LENGTH FOR RIBBED STEEL REINFORCING BARS SHALL BE 43 TIMES THE DIAMETER OF THE SMALLER LAPPED BAR UNLESS OTHERWISE SPECIFIED.
6. FOR SIZE OF PIPE OPENING EQUAL TO OR EXCEEDING 200mm, PIPE OPENING REINFORCEMENT SHALL BE PROVIDED IN ACCORDANCE WITH DRAWING NO. WSD 1.12.



Cad Ref. : WSD013901-C.dwg


| | | | |
|------|---|------------|---------|
| C | GENERAL REVISION | S.K. YEUNG | 2/1/15 |
| B | THICKNESS OF TOP SLAB AND MANHOLE OPENING REVISED | W.K. CHIU | 11/5/07 |
| A | RE-FORMATTED TO CSWP | W.K. CHIU | 5/9/03 |
| REF. | REVISION | APPROVED | DATE |

LEAKAGE COLLECTION MANHOLE -
R.C. DETAILS




水務署
Water Supplies Department

| | | | |
|----------|---------------------|-------------|----------------|
| APPROVED | M.C. LEUNG AD/NW | DRAWING NO. | CSWP |
| DATE | 6/12/01 | WSD 1.39C | (SHEET 1 OF 4) |
| SCALE | 1 : 20 | | |

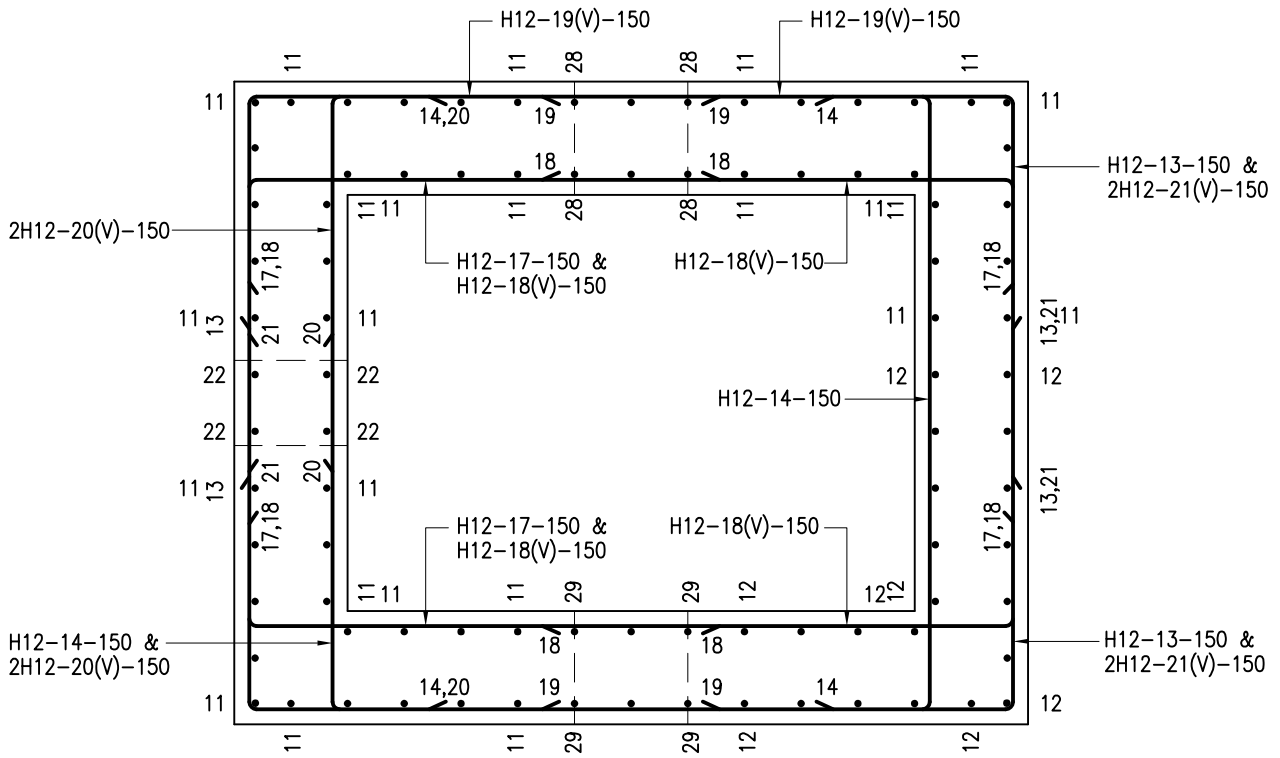

SECTIONAL PLAN




LEAKAGE COLLECTION MANHOLE –
R.C. DETAILS




水務署
Water Supplies Department

| | | | |
|-----------------|---------------------|---|------|
| APPROVED | M.C. LEUNG AD/NW | DRAWING NO. | CSWP |
| DATE | 6/12/01 | WSD 1.39C (SHEET 2 OF 4) | |
| SCALE | 1 : 20 | | |

Cad Ref. : WSD013903-C.dwg

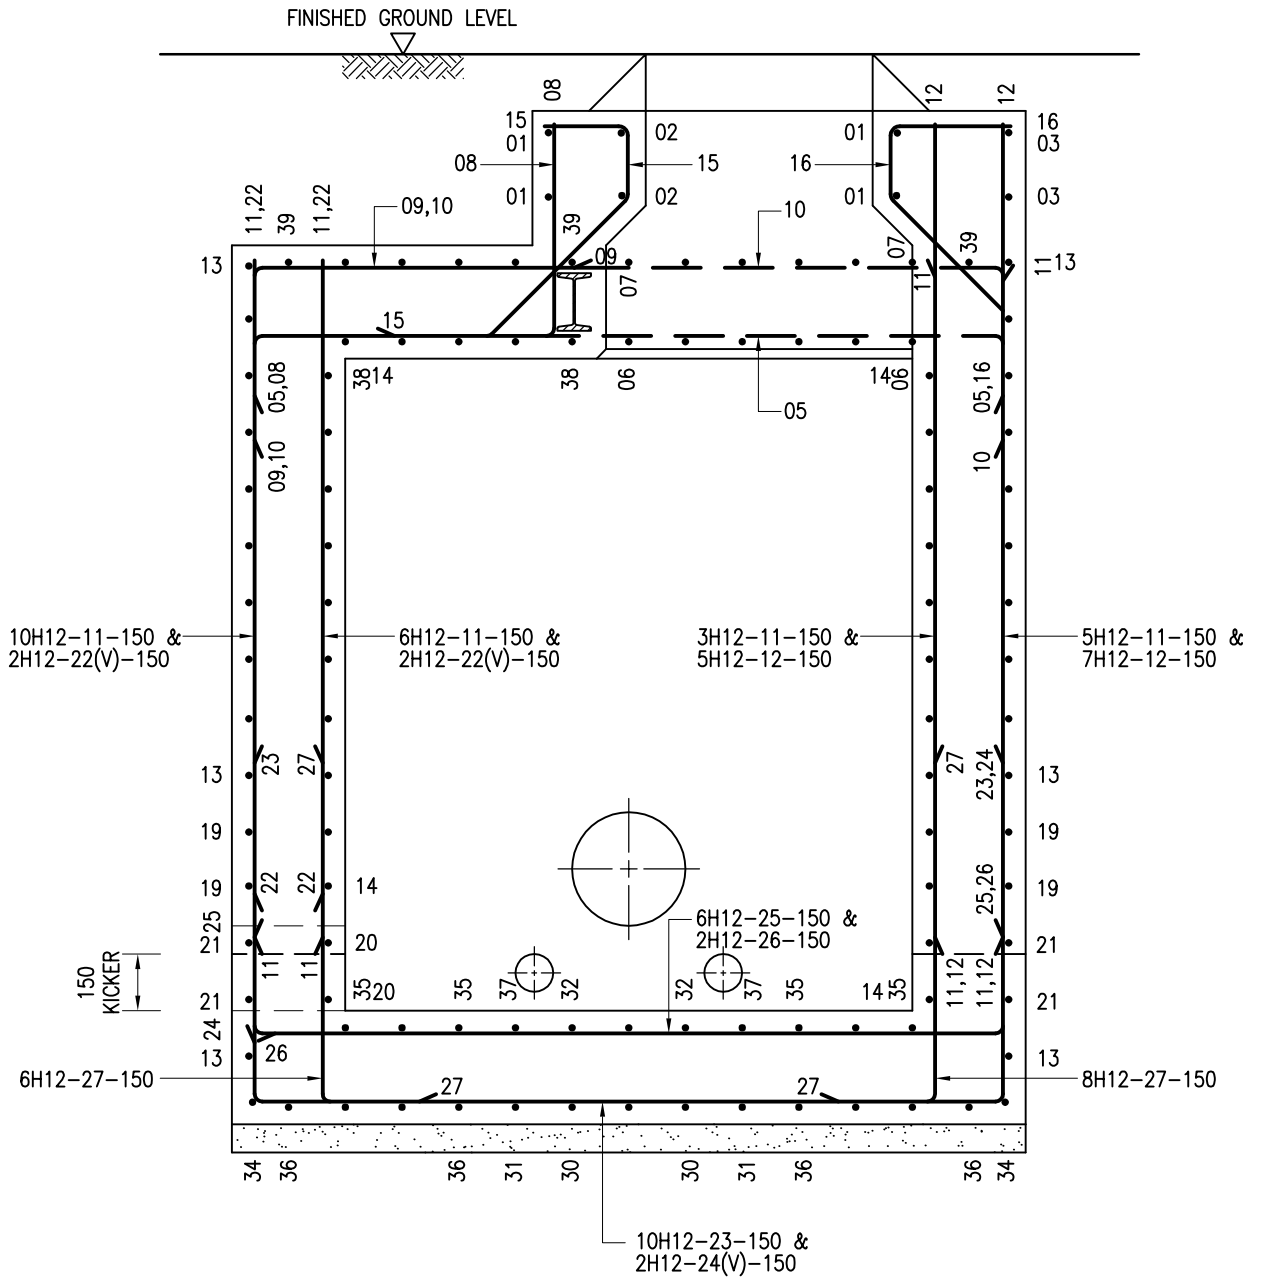

SECTION A - A




LEAKAGE COLLECTION MANHOLE -
R.C. DETAILS




水務署
Water Supplies Department

| | | | |
|----------|---------------------|--|------|
| APPROVED | M.C. LEUNG AD/NW | DRAWING NO. WSD 1.39C (SHEET 3 OF 4) | CSWP |
| DATE | 6/12/01 | | |
| SCALE | 1 : 20 | | |

Cad Ref. : WSD013904-C.dwg

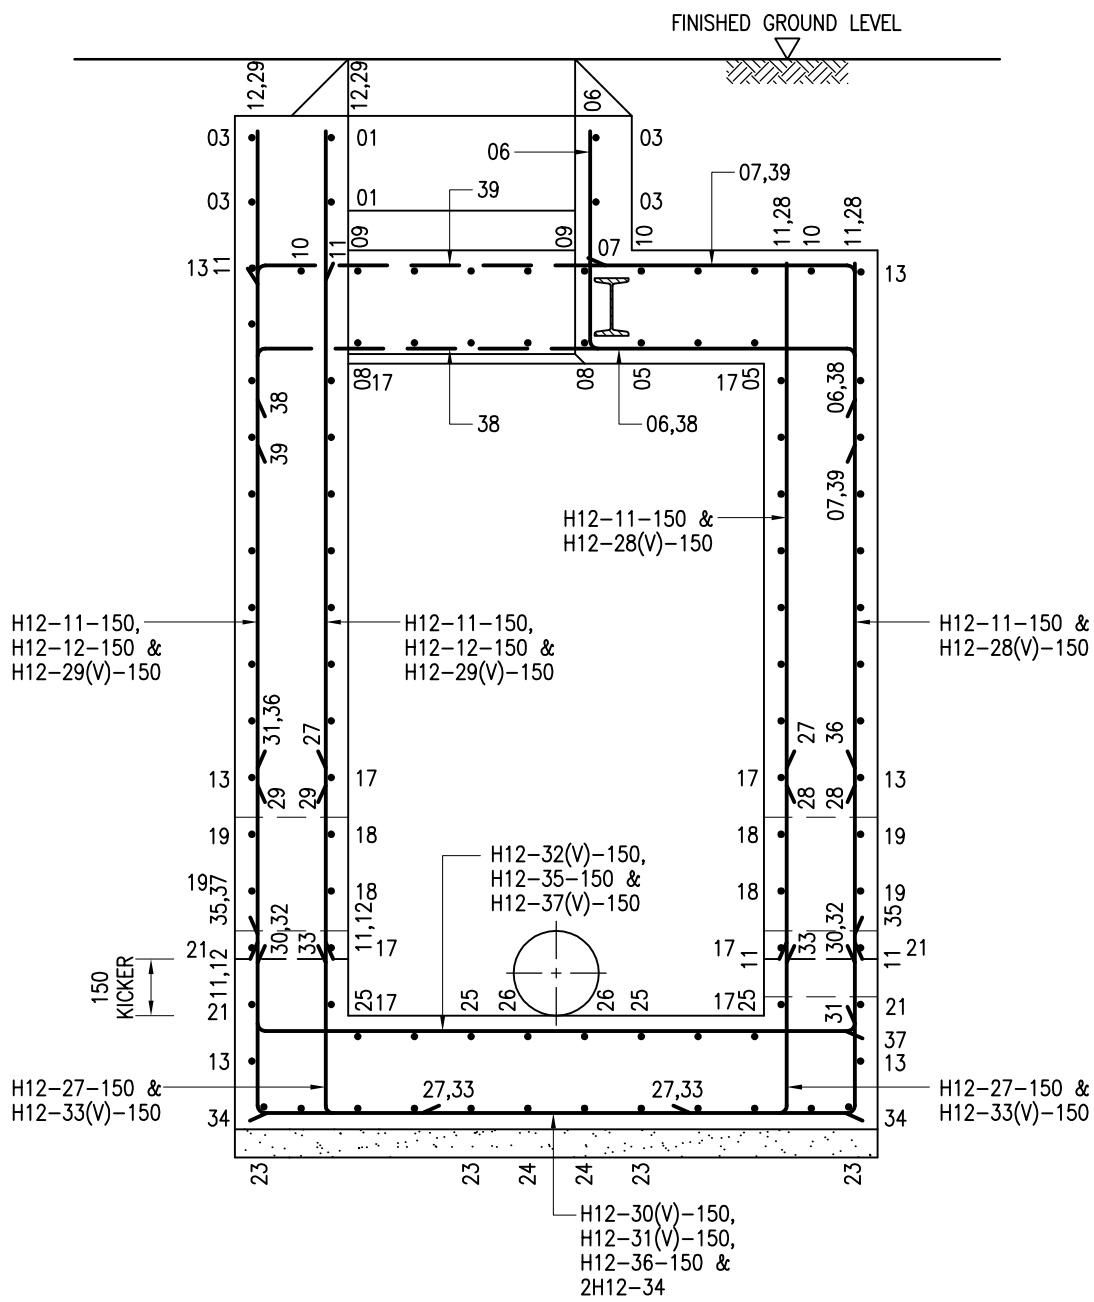

SECTION B - B



LEAKAGE COLLECTION MANHOLE - R.C. DETAILS



水務署
Water Supplies Department

APPROVED

M.C. LEUNG
AD/NW

DATE

6/12/01

SCALE

1 : 20

DRAWING NO.

WSD 1.39C

(SHEET 4 OF 4)

CSWP