


Cad Ref. : WSD014401-B.dwg

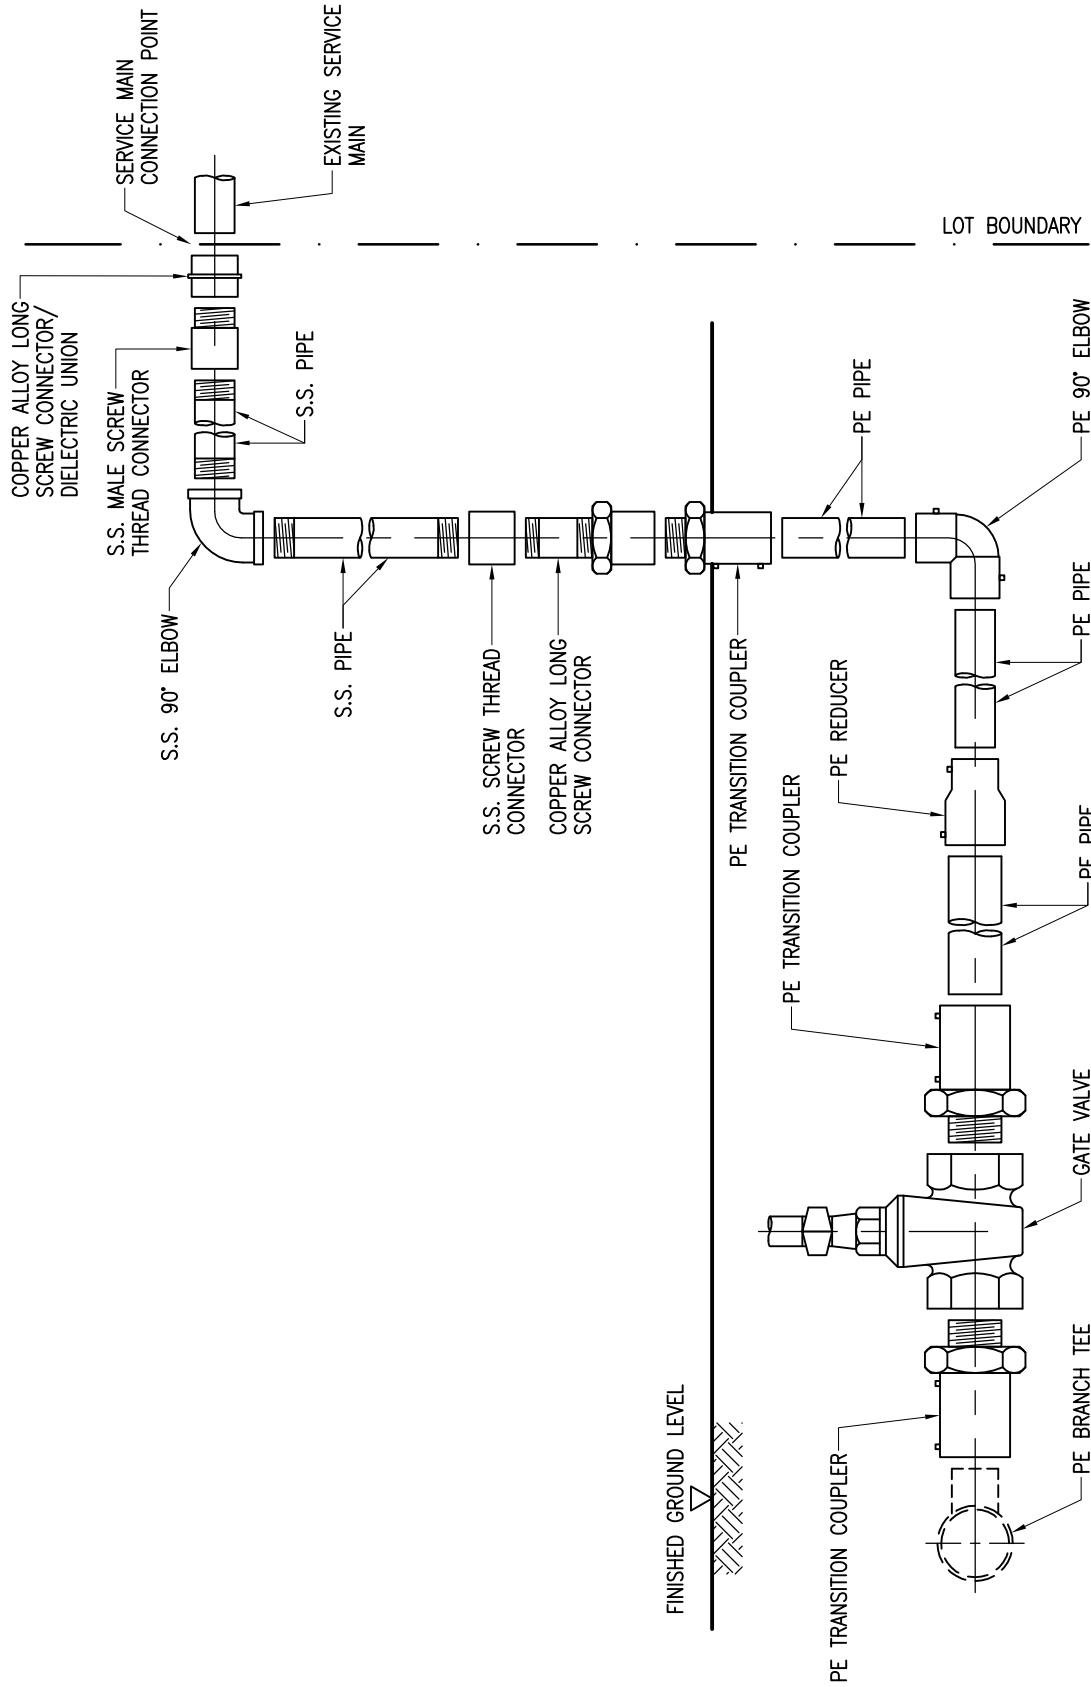

**SCHMATIC SERVICE MAIN CONNECTION ARRANGEMENT FOR FRESH WATER MAIN  
WITH STAINLESS STEEL PIPE**


SCHMATIC SERVICE MAIN  
CONNECTION

B	CONNECTION USING CORRUGATED STAINLESS STEEL TUBE ADDED	K.H. HO	15/4/21
A	GENERAL REVISION	C.M. LEE	12/2/09
REF.	REVISION	APPROVED	DATE



水務署  
Water Supplies Department

APPROVED	C.H. NG AD/NW	DRAWING NO.	CSWP
DATE	14/9/07	WSD 1.44B (SHEET 1 OF 3)	
SCALE	N.T.S.		

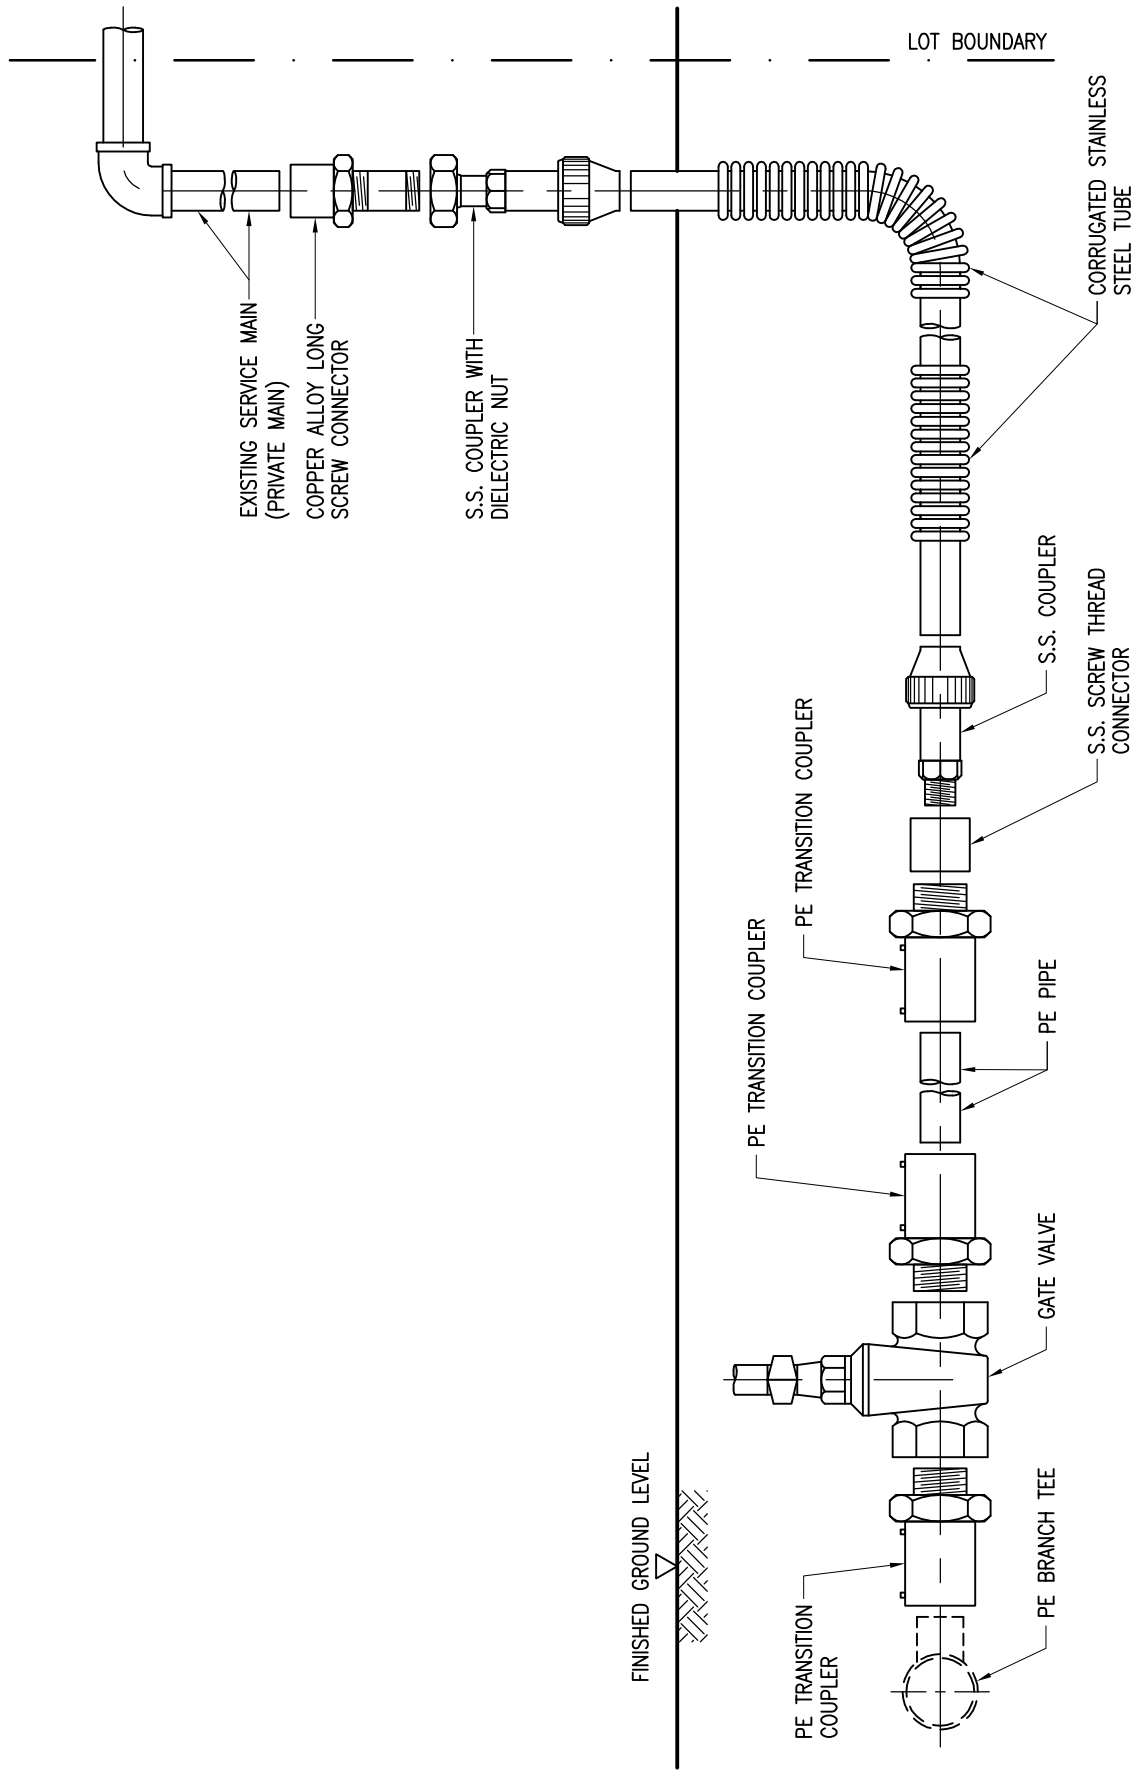

SCHEMATIC SERVICE MAIN CONNECTION ARRANGEMENT FOR FRESH WATER MAIN

WITH CORRUGATED STAINLESS STEEL TUBE

SCHEMATIC SERVICE MAIN CONNECTION



水務署  
Water Supplies Department

APPROVED

C.H. NG  
AD/NW

DATE

14/9/07

SCALE


N.T.S.

DRAWING NO.

WSD 1.44B

(SHEET 2 OF 3)

CSWP

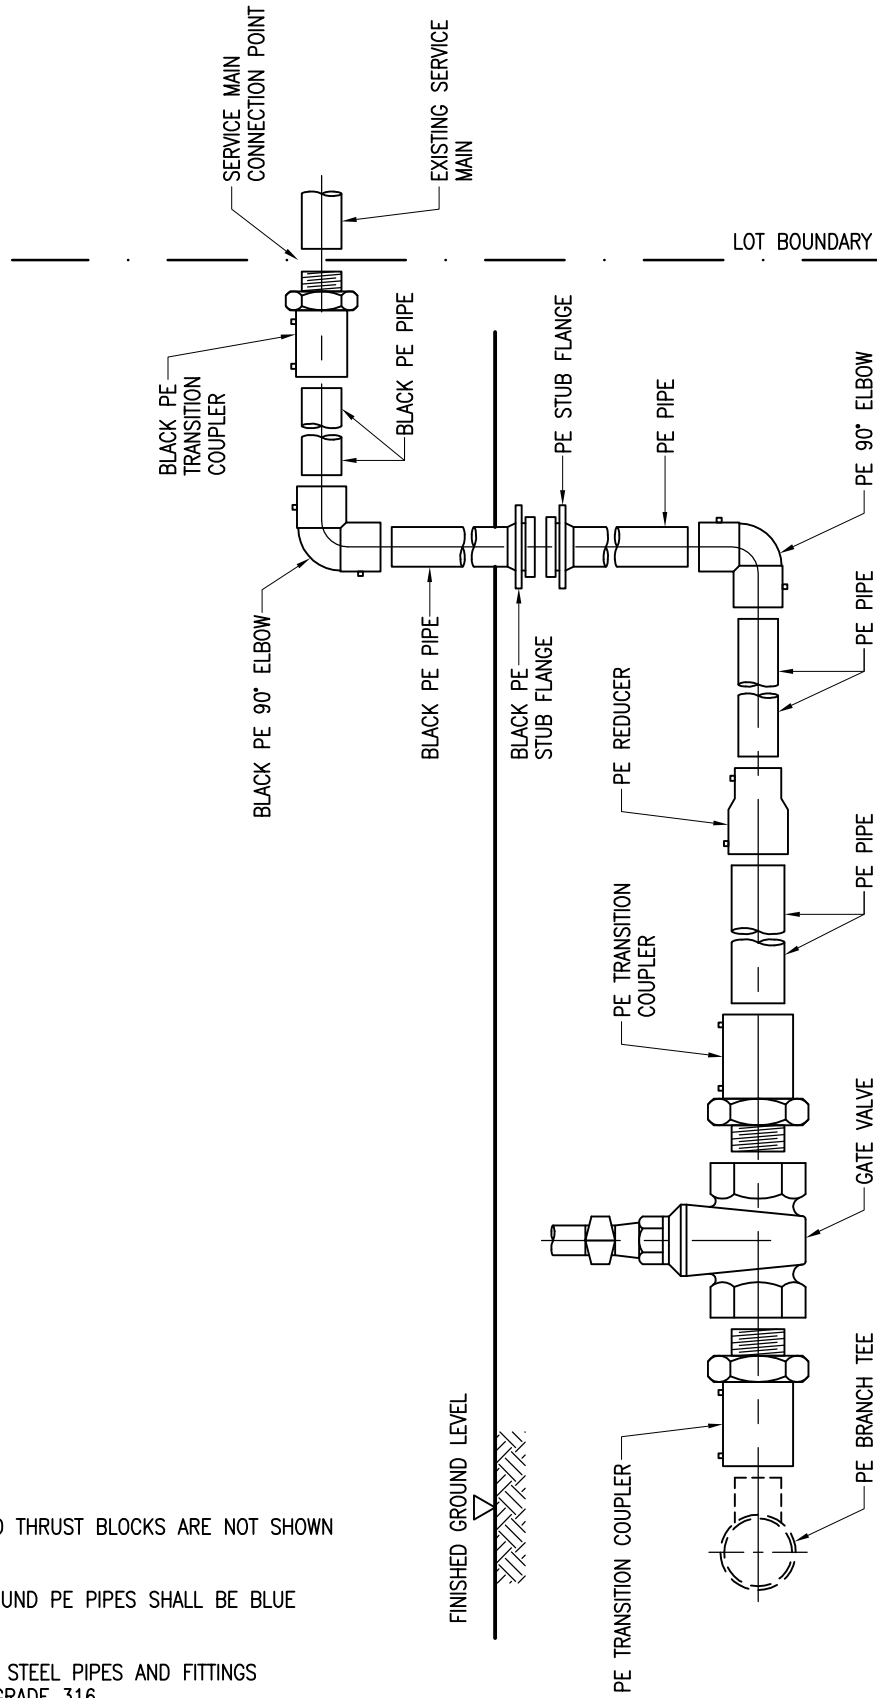

NOTES :

1. CHAMBERS AND THRUST BLOCKS ARE NOT SHOWN FOR CLARITY.
2. ALL UNDERGROUND PE PIPES SHALL BE BLUE IN COLOUR.
3. ALL STAINLESS STEEL PIPES AND FITTINGS SHALL BE IN GRADE 316.

SCHEMATIC SERVICE MAIN CONNECTION ARRANGEMENT FOR SALT WATER MAIN

SCHEMATIC SERVICE MAIN CONNECTION



水務署  
Water Supplies Department

APPROVED

C.H. NG  
AD/NW

DATE

14/9/07

SCALE

N.T.S.

DRAWING NO.

WSD 1.44B  
(SHEET 3 OF 3)

CSWP