

ROOF PLAN

NOTES :

1. THIS DRAWING IS BASED ON DRAWING ON TP 50/D1/5/01 PROVIDED IN EPD'S PRACTICE NOTE FOR PROFESSIONAL PERSONS ProPECC PN 1/94.
2. ALL DIMENSIONS ARE IN MILLIMETRES.
3. ALL REINFORCED CONCRETE SHALL BE GRADE 35/20D. BLINDING CONCRETE SHALL BE GRADE 20/20D.
4. SURFACE WATER DRAIN SHALL NOT BE CONNECTED TO THE TANK.
5. SLUDGE SHALL BE REMOVED EVERY 6 MONTHS.
6. ULTIMATE WATER CONSUMPTION IS ASSUMED TO BE 185 LITRES/CAPITA/DAY.
7. THE NUMBER OF PERSONS SERVED BY THE SEPTIC TANK SHOWN ON THIS DRAWING SHALL BE UNDER 16.
8. FOR DETAILS OF STEP IRON REFER TO DRG. NO. WSD 7.8.
9. FOR DETAILS OF CAT-LADDER REFER TO DRG. NO. WSD 7.3.
10. MANHOLE COVER SHALL BE AS SHOWN ON DRG. NO. WSD 7.48.


SEPTIC TANK - GENERAL ARRANGEMENT

B	RE-FORMATTED TO CSWP	W.K. CHIU	14/11/03
A	SEPTIC TANK REVISED	W.K. CHIU	6/12/01
REF.	REVISION	APPROVED	DATE



水務署
Water Supplies Department

APPROVED	G.C. LEE AD/NW	DRAWING NO. WSD 7.9B (SHEET 1 OF 4)	CSWP
DATE	9/6/92		
SCALE	N.T.S.		

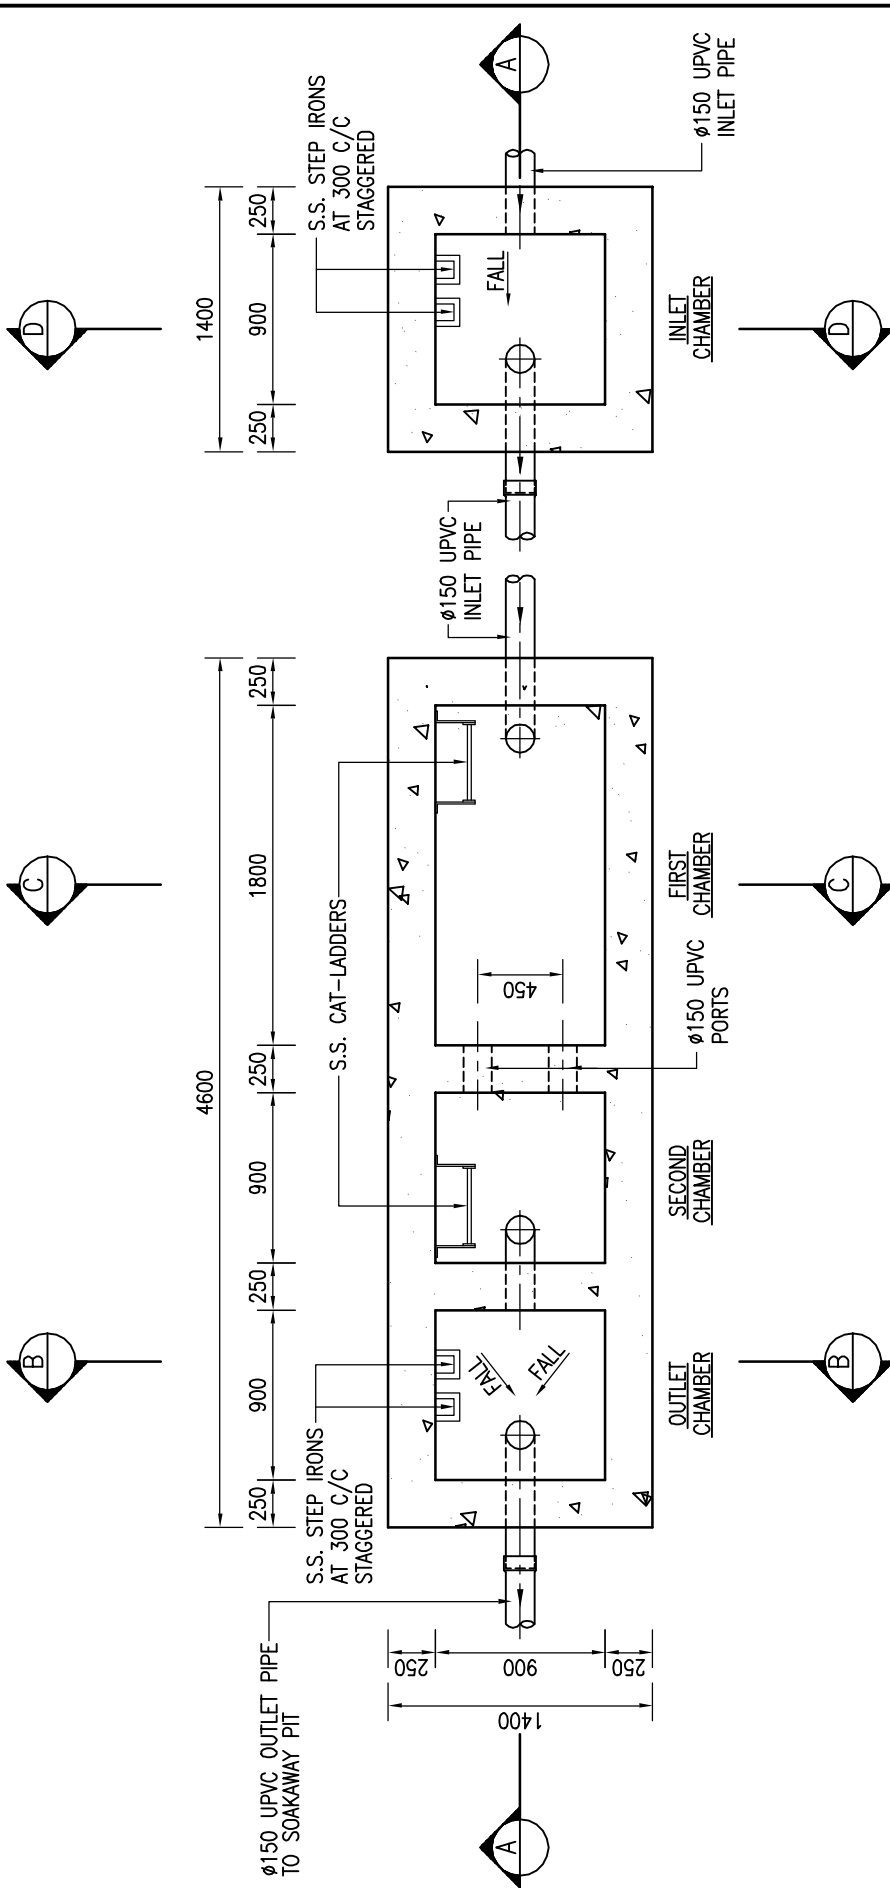

SECTIONAL PLAN


SEPTIC TANK -
GENERAL ARRANGEMENT



水務署
Water Supplies Department

APPROVED	G.C. LEE AD/NW	DRAWING NO. WSD 7.9B (SHEET 2 OF 4)	CSWP
DATE	9/6/92		
SCALE	N.T.S.		

Cad Ref. : WSD070903-B.dwg

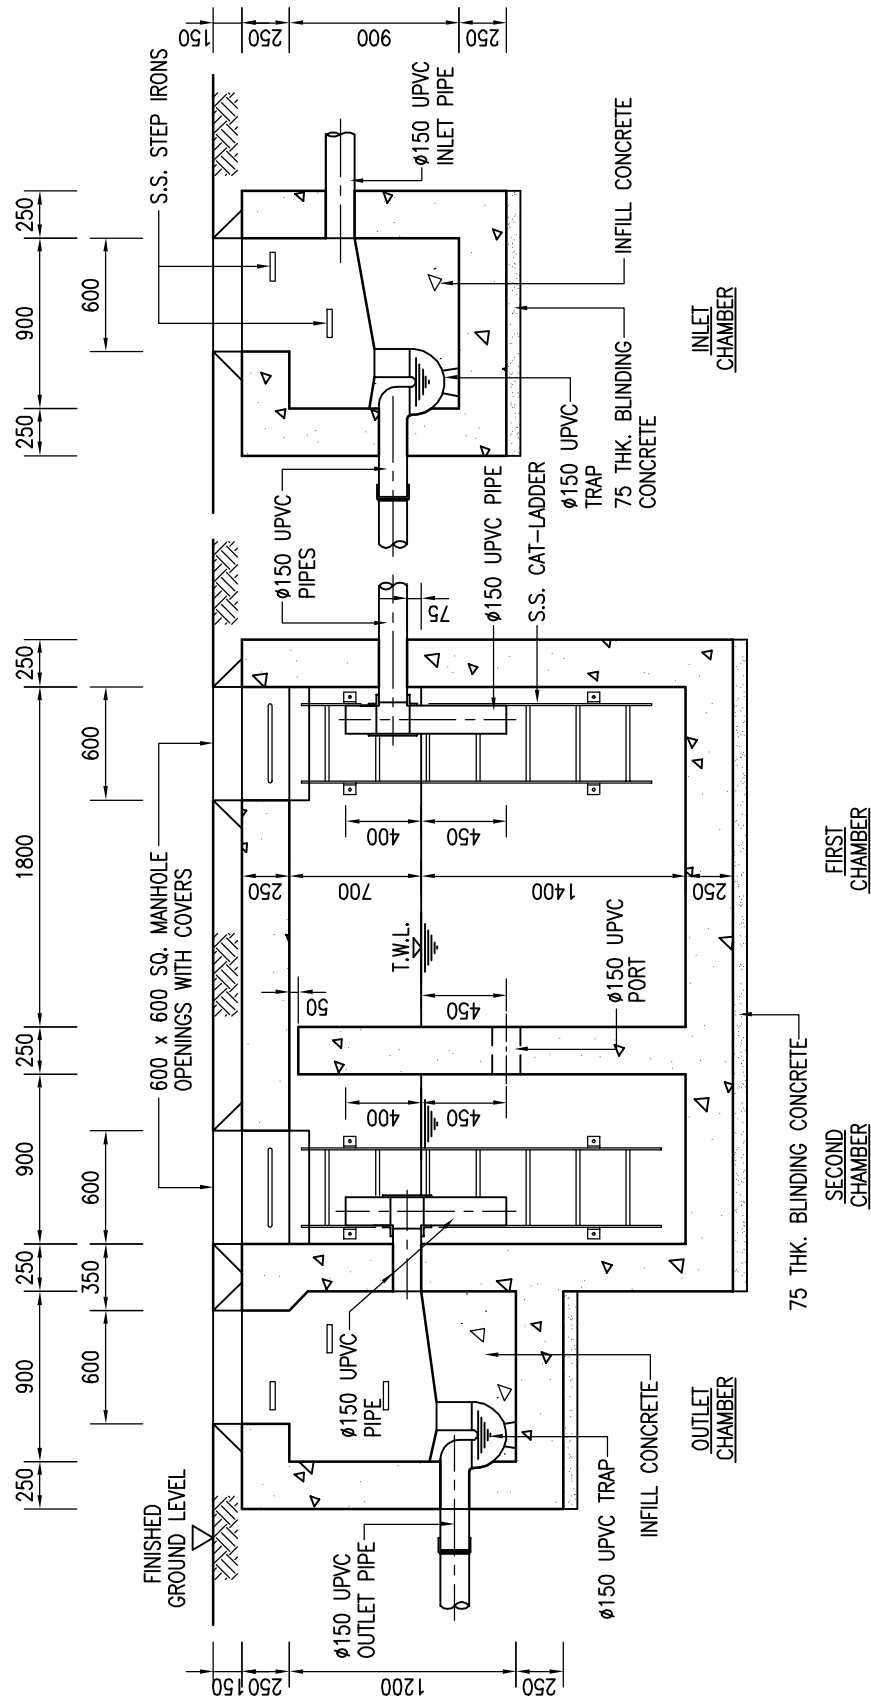


SECTION A - A

SEPTIC TANK -
GENERAL ARRANGEMENT




水務署
Water Supplies Department


APPROVED	G.C. LEE AD/NW	DRAWING NO. WSD 7.9B (SHEET 3 OF 4)	CSWP
DATE	9/6/92		
SCALE	N.T.S.		

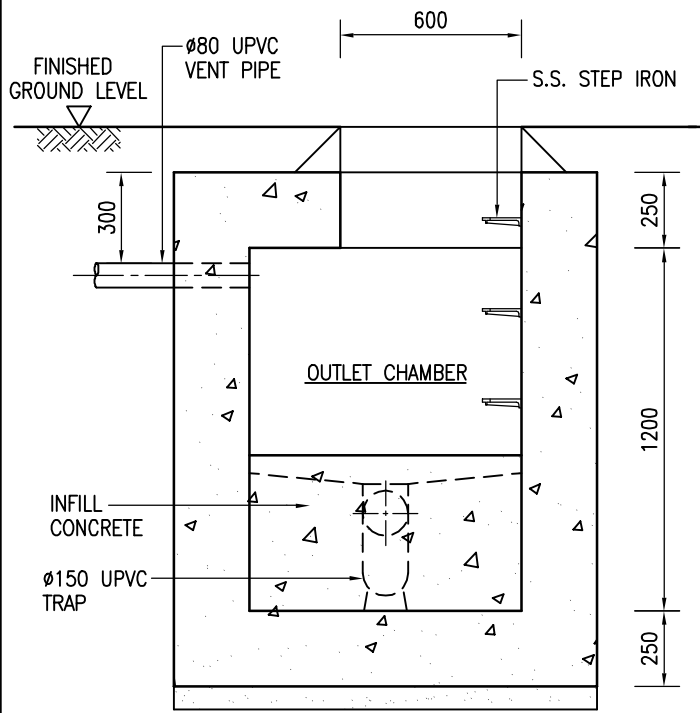


SECTION B - B

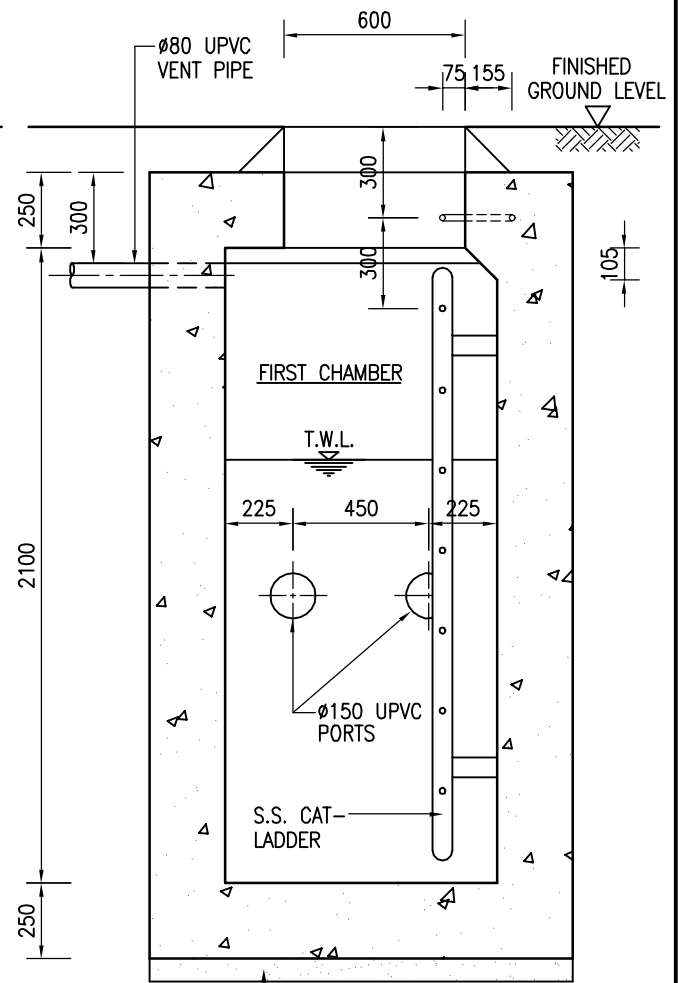

SECTION C - C

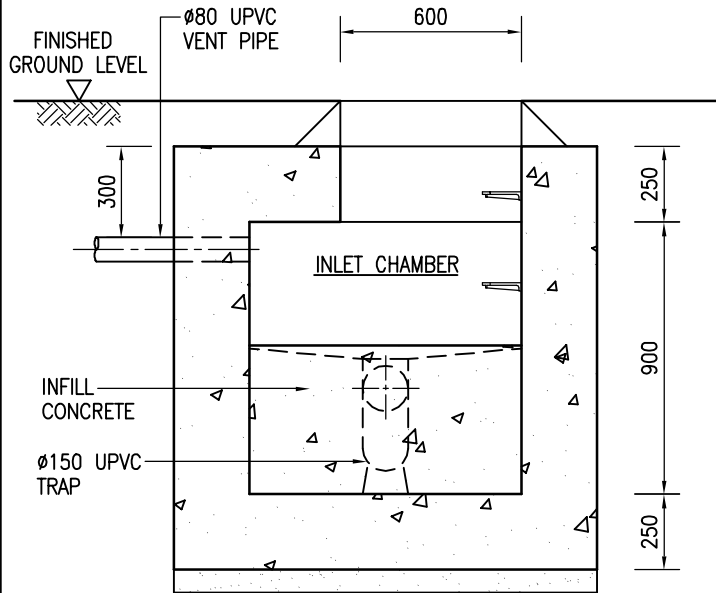

SECTION D - D



Cad Ref. : WSD070904-B.dwg



水務署
Water Supplies Department

SEPTIC TANK -
GENERAL ARRANGEMENT

APPROVED	G.C. LEE AD/NW	DRAWING NO. WSD 7.9B (SHEET 4 OF 4)	CSWP
DATE	9/6/92		
SCALE	1 : 25		